



26-0337_DCBlox_IndyDC_Reference Sound Levels Letter-260701.docx

July 1, 2026

Epsilon Ref. 26-0337

Mr. Spencer Humphrey, PE
Associate Principal
Langan
Via email: shumphrey@langan.com

**Subject: Reference Sound Level Report
Indianapolis Data Center Project – Indianapolis, Indiana**

Dear Spencer:

Epsilon Associates, Inc. (Epsilon) is pleased to provide this brief report on a reference sound level measurement program conducted for the proposed data center project with Phase 1 (10 MW tenant load) and Phase 2 (up to 40 MW) located in the Eastgate neighborhood of Indianapolis, Indiana to the south of E. Washington Street and west of S. Shadeland Avenue (the Project). The Project is being developed by DC Blox who has established a site requirement sound level of 65 dBA (L_{max}) at their property boundary. Additionally, DC Blox is committed to minimizing low frequency impacts from the Project through diligent study and engineering.

The purpose of this program was to quantify sound levels from an operational data center at distances comparable to those applicable to the Project. DC Blox's Atlanta-East data center in Conyers, Georgia was utilized for the reference measurements. The study methodology and results are described herein with a primer on acoustic terminology included as an attachment.

Measurement Methodology Overview

Programmable, unattended sound level meters were placed at three (3) measurement locations on DC Blox property to the west of the existing Atlanta-East data center. The meters continuously measured sound levels from approximately 2:00pm on Wednesday, June 10, 2026 to 3:30pm on Thursday, June 11, 2026. The 24-hour measurement period allowed for a characterization of how sound levels change over the course of the day due to the data center operation as well as various existing sound sources that impact community sound levels such as traffic, commercial activity, or natural sounds. Sound levels were measured at a height of approximately five feet above the ground at locations selected to minimize local reflections and to accommodate setback distances applicable to the data center Project in Indianapolis, which are detailed as follows.

1. Shortest distance from proposed generator to Project property line = ~250 feet
2. Shortest distance from proposed rooftop equipment to Project property line in the direction of the closest residences = ~470 feet
3. Shortest distance from proposed rooftop equipment to the closest residence = ~650 feet

Three (3) locations on DC Blox property were utilized to measure the reference sound level data as shown in Figure 1. Given the active construction at the property (see next section), equipment placement options were limited. As a result, microphones were placed within approximately 50 feet of the targeted setback distances, with ML1 being the closest measurement location and ML3 being the farthest measurement location.

Sound level measurements were made using Larson Davis Model 831C or Norsonic Nor140 sound level meters each equipped with a microphone, preamplifier, and large windscreen. This instrumentation meets "Type 1 Precision" requirements set forth in American National Standards Institute (ANSI) S1.4 standard for sound level meters. The measurement equipment was calibrated in the field before and after the survey with a Larson Davis CAL200 acoustical calibrator which meets the standards of IEC 942 Class 1L and ANSI S1.40. Broadband sound levels (e.g., L_{max} , L_{90} , L_{eq} , etc.) were measured in 15-minute logging intervals and a one-second time history. The meters also measured one-third octave band sound levels from 6.3 Hz to 20,000 Hz, which includes low frequencies (20 to 200 Hz) and infrasound (below 20 Hz). Sound levels down to 0.4 Hz were measured at location ML3.

Meteorological conditions were periodically sampled by field personnel via handheld instrumentation. No precipitation occurred during the measurement period.

Atlanta-East Data Center Operations and Site Conditions

The Atlanta-East data center operational load is tenant driven. The facility currently operates with some load to accommodate the critical IT operations for the building systems based on Epsilon's understanding. The total power draw is currently 120kW of a design of ~2,600kW, based on the installed 2MW critical power capacity.

The primary outdoor noise-producing equipment is as follows.

- (2) 3MW diesel generators
- (10) 40kW (11 ton) electrical room/IT room computer room air conditioner (CRAC) units
- (5) 500kW (142 ton) data hall CRAC units
- (2) 5.4kW (1.5 ton) split systems
- (1) 10kW (3 ton) split system
- (1) 35kW (10 ton) make up air unit
- (1) 50kW (15 ton) roof top unit

Except for the diesel generators, the equipment listed above (all HVAC) was running as needed during the 24-hour sound measurement program based on building load, whereas forcing full-load conditions onto the equipment was infeasible without risking significant damage to the equipment. Field personnel-sampled ambient outdoor temperatures, which influence HVAC operation, ranged from 77 to 91°F during the program.

Power from the two diesel generators at the facility was not needed during the measurement program due to low load; however, they were manually operated at full load from 5:30pm through about 6:03pm on June 10th, which allowed for sound data collection with them operating for two complete 15-minute blocks.

The Atlanta-East data center is undergoing an expansion immediately adjacent to the existing facility to the southwest and west. As such, construction, heavy at times, occurred during the 24-hour sound sampling period, which put some constraint on the monitoring equipment placement for safety and obstruction considerations. This onsite construction began at approximately 7:00am and continued until approximately 5:00pm. While onsite construction ceased between 5:00pm and 7:00am, other construction activity occurred during this window at the property south of Lester Road NW, about 1,200 feet from the measurement locations. This activity, largely rock crushing, was audible during the generator testing and impacted certain sound level metrics, e.g., L_{max} .

Measurement Results (Reference)

Sound sources generally observed from the measurement locations include construction both onsite and offsite, traffic on major roadways and locally, amphibians (at night), birds, and aircraft. Data center HVAC equipment was essentially inaudible at the measurement locations. The generators, when operating, were clearly audible at all three locations during the test.

Broadband Sound Levels

A graphical presentation of broadband A-weighted (dBA), most representative of human hearing for most sounds, and broadband C-weighted (dBC), best used for quantifying loud sounds, sound levels measured throughout the 24-hour measurement program at locations ML1, ML2, and ML3 are shown in the attached Figures 2, 3, and 4, respectively.¹ The periods of onsite construction activity and the generator operation sound testing period (5:30-6:00pm) are shaded. A few takeaways and notes from the plots:

¹ C-weighted L_{max} and L_{90} sound levels were not measured due to instrumentation limitations and are therefore not presented.

- a. Construction activity and the generators have an observable impact on the sound levels.
- b. The difference between the C-weighted L_{eq} and the A-weighted L_{eq} is frequently on the order of 10-15 dB, even when onsite construction has ceased and the generators are not running.
- c. The swell in the A-weighted L_{eq} and L_{90} levels at night, most notable at ML1 in Figure 2, is driven by constant natural sounds including amphibians observed in an adjacent pond.
- d. The A-weighted L_{max} levels are mostly driven by construction activities. Other sources contributing to the L_{max} levels may include amphibians and aircraft.

Fractional Band Sound Levels

Infrasound

The attached Table 1 presents measured one-third octave band sound levels ranging from 6.3 Hz to 20,000 Hz, which covers infrasound, low frequency, and mid-high frequency. All presented levels are unweighted (dB) L_{eq} sound levels, which are the time-weighted average levels. Specific 15-minute logging periods (12:00am, 6:00am, 12:00pm, 5:30pm, and 8:00pm) are presented for each location to emphasize the variation over the day. A period when the generators were running (5:30pm) and when onsite construction was occurring (12:00pm) are included.

Prominent Discrete Tones

All logged periods were quantitatively assessed for prominent discrete tones, i.e., sounds that may stand out to an observer based on the tonal content and volume, such as a squeal. ANSI S12.9-2021/Part 4 provides the following definition:

For a prominent discrete tone to be identified as present, the time-average sound pressure level in the one-third-octave band of interest is required to exceed the time-average sound pressure level for the two adjacent one-third-octave band by some constant level difference.

The constant level difference may vary with frequency. Possible choices for the level differences are: 15 dB in low-frequency one-third-octave bands (25-125 Hz), 8 dB in middle-frequency bands (160-400 Hz), and 5 dB in high-frequency bands (500-10,000 Hz).

The definition is for frequencies from 25 to 10,000 Hz, ignoring infrasound (below the threshold of human hearing). The attached Tables 2A through 2C present the PDT assessments for locations ML1 through ML3, respectively, using L_{eq} ("time-average") sound levels as prescribed. PDTs are shaded and are shown to occur at some frequencies that are 1,000 Hz and above with none at low frequencies. No PDTs occurred during the generator testing period at any location. The PDTs at 4,000 Hz overnight

at each location are likely caused by amphibians. The cause(s) of other PDTs have not been investigated.

Vibration Perceptibility

ANSI S12.9-2021/Part 4 also contains acoustically induced vibration and rattles criteria for evaluating their perceptibility from sound levels, i.e., airborne. These criteria are concentrated around low frequency sound at high sound pressure levels and are defined to identify moderately perceptible and clearly perceptible vibration and rattles in lightweight wall and ceiling structures, such as residences. Table 3 presents the criteria set by the ANSI standard. The likelihood of vibration perceptibility would be lower in heavier-weight structures from these sound levels.

Table 3

Perceptibility	Sound Level Threshold (dB) by Octave Band Frequency (Hz)		
	16 Hz	31.5 Hz	63 Hz
Moderate	65	65	70
Clear	75	75	80

The attached Table 4 presents an assessment of all logged periods against these criteria at each location using L_{eq} sound levels for consistency with the PDT assessment. Moderately perceptible vibration would be anticipated from the sound levels in the table shaded in light gray. These are evidently during onsite construction periods (from approximately 7:00am through 5:00pm) at all three locations and in all three frequency bands. This moderate perceptibility is also shown at all three locations during the periods when the generators were running in the 16 Hz and 63 Hz bands. A total of two periods at ML2 show clearly perceptible vibration was likely, but not when the generators were running. These exceedances are expected to be caused by local construction activity, though the cause(s) of each exceedance have not been investigated.

Conclusion

Epsilon completed a reference sound level measurement program and quantified sound levels in the vicinity of the existing operational Atlanta-East data center in Conyers, Georgia. Sound levels measured during the 24-hour program were heavily influenced by onsite and other local construction. Data center HVAC equipment was essentially inaudible at the measurement locations during the program, but the generators, when operating, were audible at all three locations during the test as general mechanical sound.

Importantly, the measurement locations at the Atlanta-East data center were all on the data center property with direct line of sight of the generators. In contrast, the conceptual Indianapolis Project layout includes two buildings with all generators interior to the building arrangement in utility yards,

largely preventing line of sight of the generators to the majority of the Project's parcel boundary and neighbors. Eliminating line of sight is beneficial for acoustical screening. The Project design also includes solid sound walls at the ends of the utility yards, further preventing line of sight and limiting offsite sound from the Project, and an 8-foot earthen berm to the north for additional screening.

If you have any questions on this letter, please feel free to call me at (978) 461-6232 or e-mail me at ccyr@epsilonassociates.com.

Sincerely,
EPSILON ASSOCIATES, Inc.



Clinton D. Cyr, PE, INCE Board Certified
Lead Engineer

Attachments

- Sound Terminology
- Figure 1 – Measurement Locations
- Figure 2 – Monitoring Graphical Results ML1
- Figure 3 – Monitoring Graphical Results ML2
- Figure 4 – Monitoring Graphical Results ML3
- Table 1 - One-Third Octave Band Sound Levels (6.3 Hz to 20,000 Hz)
- Table 2A, 2B, 2C – Prominent Discrete Tone Assessment
- Table 4 – Vibration Perceptibility Assessment

Sound Terminology

There are several ways in which sound levels are measured and quantified. All of them use the logarithmic decibel (dB) scale. The following information defines the sound level terminology used in this analysis.

The decibel scale is logarithmic to accommodate the wide range of sound intensities found in the environment. A property of the decibel scale is that the sound pressure levels of two or more separate sounds are not directly additive. For example, if a sound of 50 dB is added to another sound of 50 dB, the total is only a 3-decibel increase (53 dB), which is equal to doubling in sound energy, but not equal to a doubling in decibel quantity (100 dB). Thus, every 3-dB change in sound level represents a doubling or halving of sound energy. The human ear does not perceive changes in the sound pressure level as equal changes in loudness. Scientific research demonstrates that the following general relationships hold between sound level and human perception for two sound levels with the same or very similar frequency characteristics¹:

- 3 dB increase or decrease results in a change in sound that is just perceptible to the average person,
- 5 dB increase or decrease is described as a clearly noticeable change in sound level, and
- 10 dB increase or decrease is described as twice or half as loud.

Another mathematical property of decibels is that if one source of sound is at least 10 dB louder than another source, then the total sound level is simply the sound level of the higher-level source. For example, a sound source at 60 dB plus another sound source at 47 dB is equal to 60 dB.


A sound level meter (SLM) that is used to measure sound is a standardized instrument.² It contains “weighting networks” (e.g., A-, C-, Z-weightings) to adjust the frequency response of the instrument. Frequencies, reported in Hertz (Hz), are detailed characterizations of sounds, often addressed in musical terms as “pitch” or “tone”. The most commonly used weighting network is the A-weighting because it most closely approximates how the human ear responds to sound at various frequencies. The A-weighting network is the accepted scale used for community sound level measurements; therefore, sounds are frequently reported as detected with a sound level meter using this weighting. A-weighted sound levels emphasize middle frequency sounds (i.e., middle pitched – around 1,000 Hz) and de-emphasize low and high frequency sounds. These sound levels are reported in decibels designated as “dBA”. The C-weighting network has a nearly flat response for frequencies between 63 Hz and 4,000 Hz and is noted as dBC. Z-weighted sound levels are measured sound levels without any weighting curve and are otherwise referred to as “unweighted”.

¹ Bies, David, and Colin Hansen. 2009. *Engineering Noise Control: Theory and Practice*, 4th Edition. New York: Taylor and Francis.

² *American National Standard Specification for Sound Level Meters*, ANSI S1.4-2014 (R2019), published by the Standards Secretariat of the Acoustical Society of America, Melville, NY.

Because the sounds in our environment vary with time they cannot simply be described with a single number. Two methods are used for describing variable sounds. These are exceedance levels and the equivalent level, both of which are derived from a large number of moment-to-moment A-weighted sound level measurements. Exceedance levels are values from the cumulative amplitude distribution of all of the sound levels observed during a measurement period. Exceedance levels are designated L_n , where n can have a value between 0 and 100 in terms of percentage. Several sound level metrics that are commonly reported in community sound monitoring studies are described below.

- $L_{\max}$ is the maximum sound level over a given time period. The $L_{\max}$ is typically due to discrete, identifiable events such as an airplane overflight, car or truck passby, or a dog bark for example.
- L_{eq} , the equivalent level, is the level of a hypothetical steady sound that would have the same energy (*i.e.*, the same time-averaged mean square sound pressure) as the actual fluctuating sound observed. The equivalent level is designated L_{eq} and is typically A-weighted. The equivalent level represents the time average of the fluctuating sound pressure, but because sound is represented on a logarithmic scale and the averaging is done with linear mean square sound pressure values, the L_{eq} is mostly determined by loud sounds if there are fluctuating sound levels.
- L_{90} is the sound level exceeded 90 percent of the time during the measurement period. The L_{90} is close to the lowest sound level observed. It is essentially the same as the residual sound level, which is the sound level observed when there are no obvious nearby intermittent sound sources.

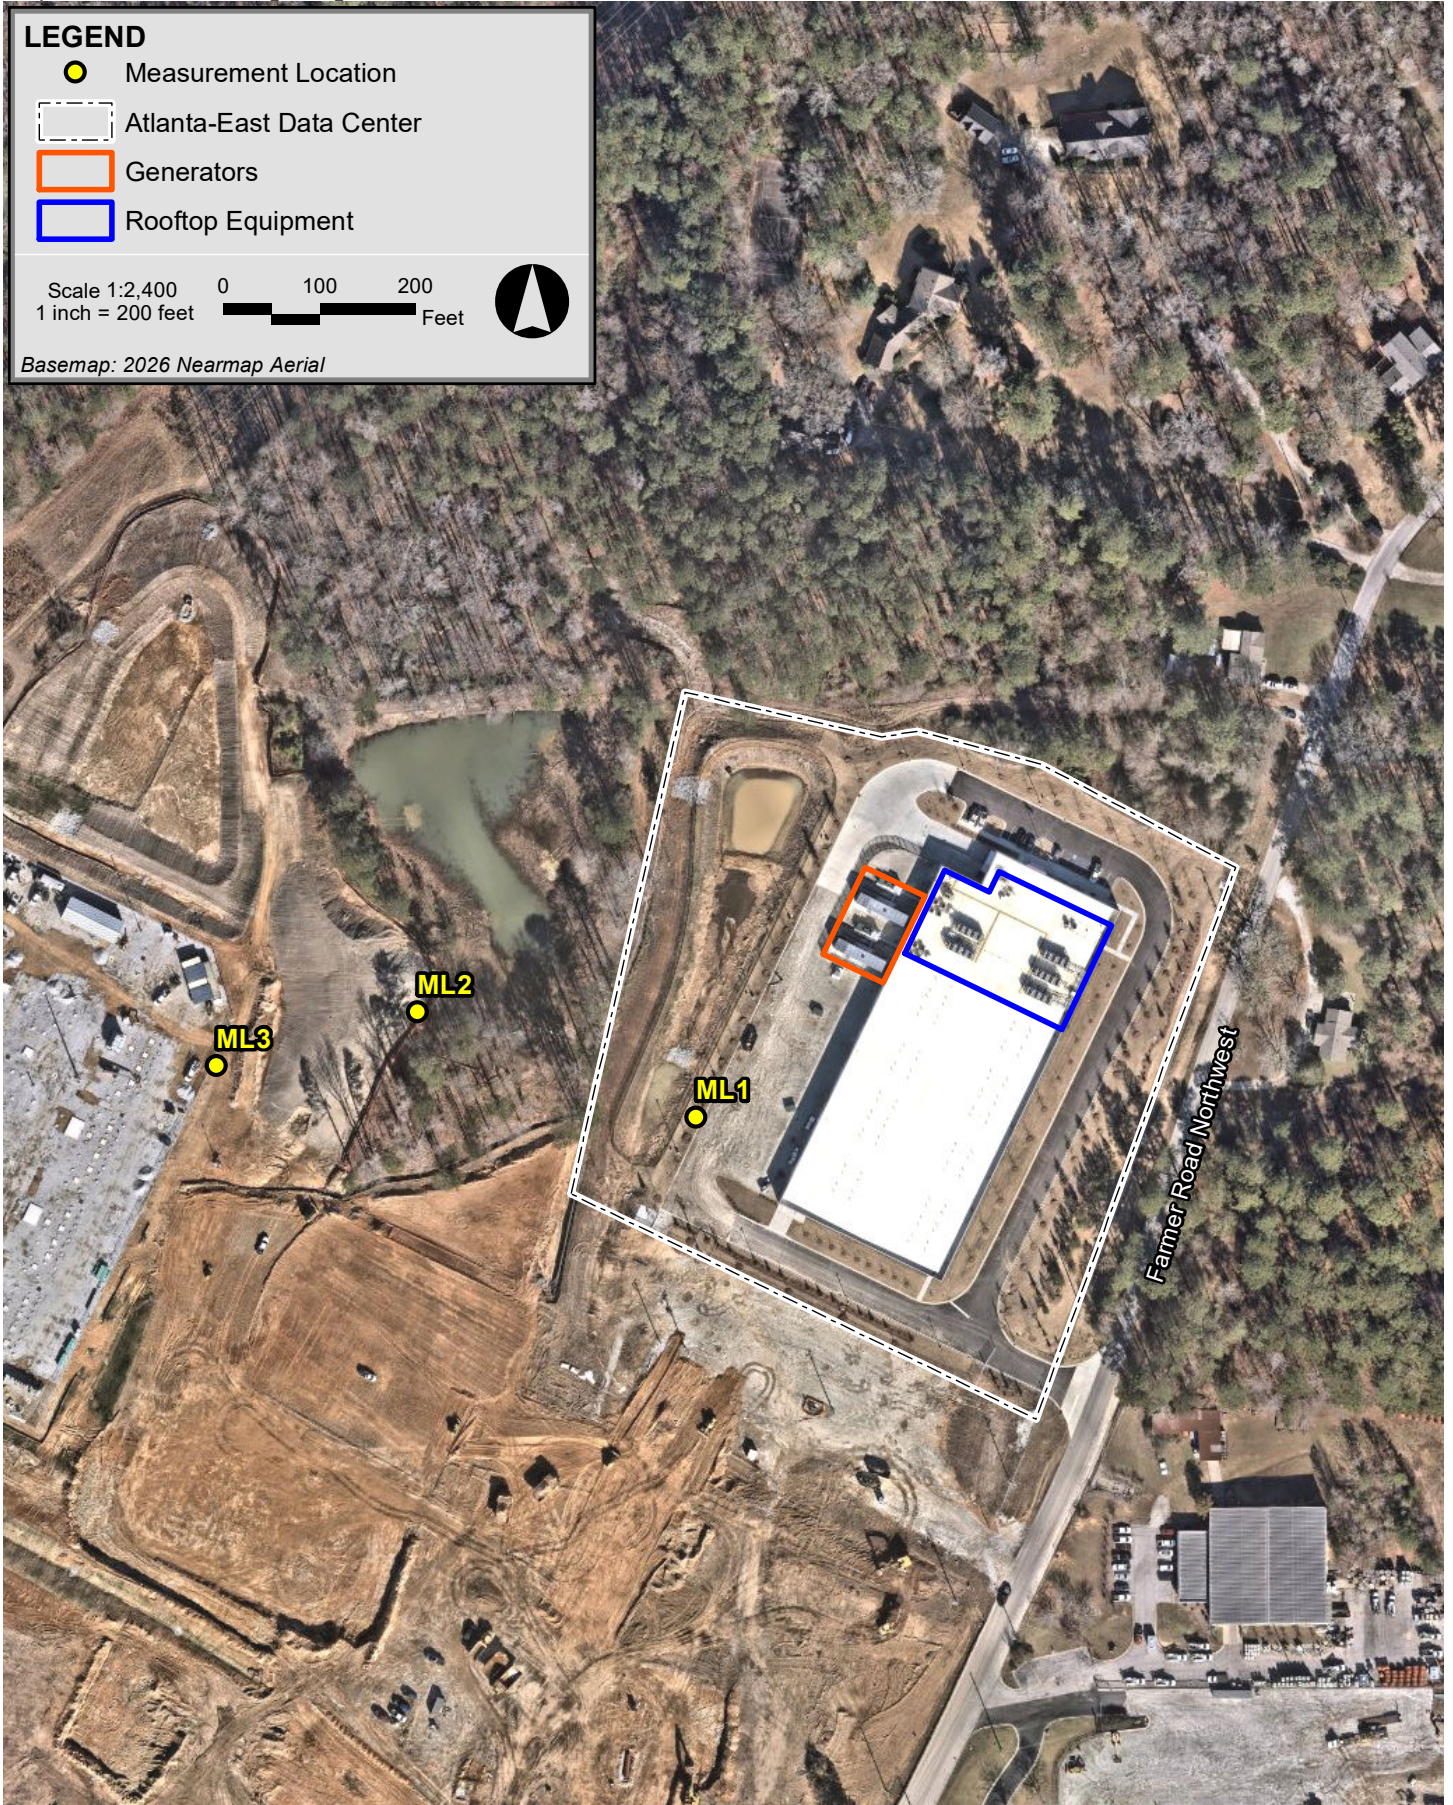

Atlanta-East Data Center Conyers, Georgia

Figure 2
Monitoring Graphical Results ML1
15-Minute Sound Level Data

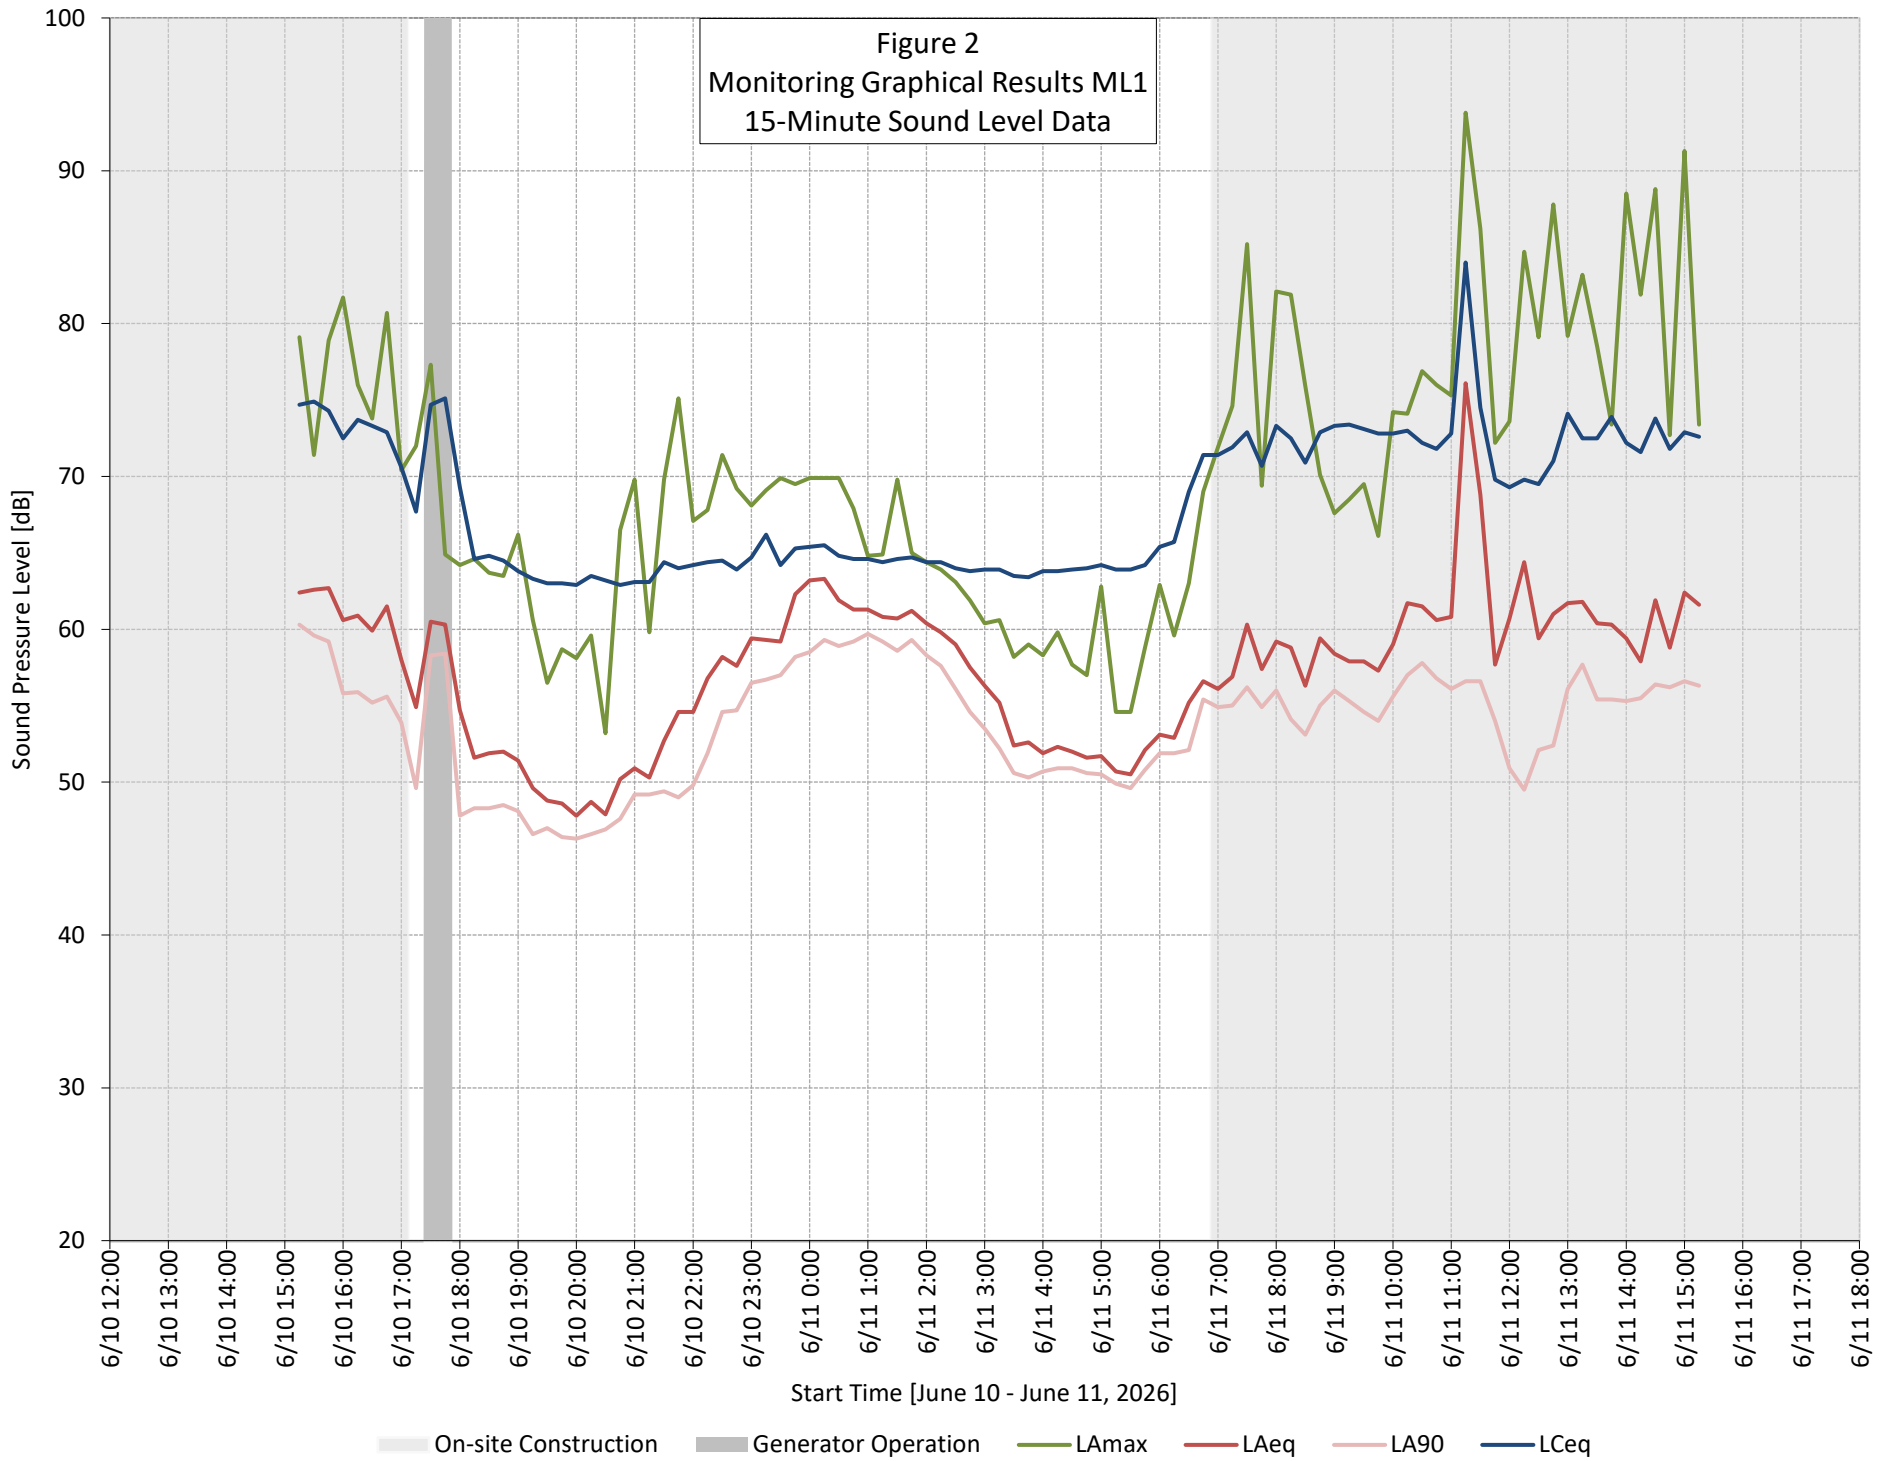


Figure 3
Monitoring Graphical Results ML2
15-Minute Sound Level Data

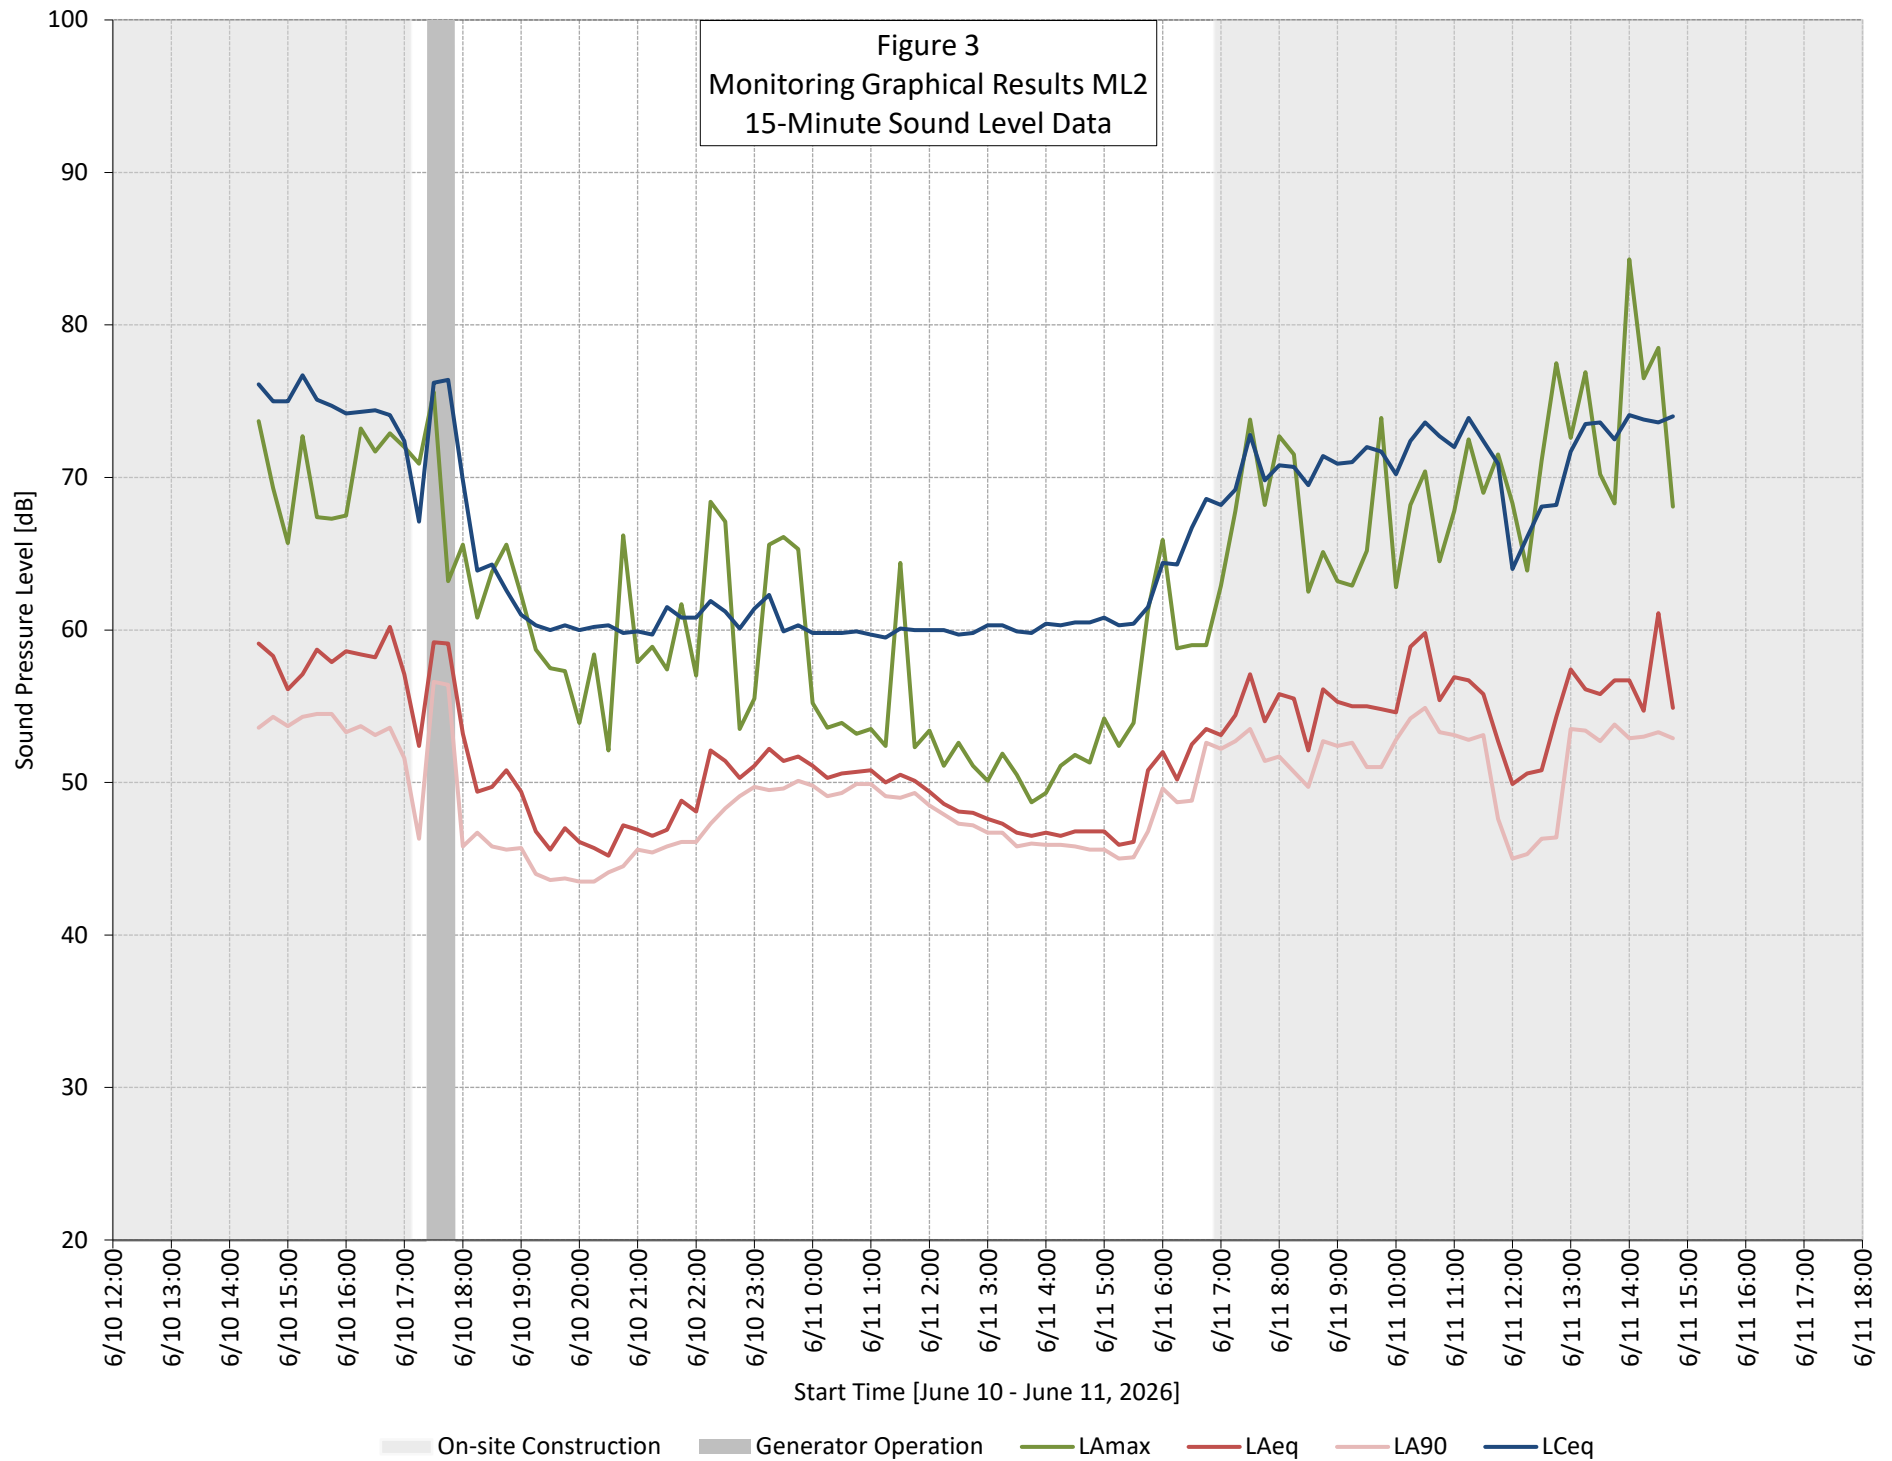


Figure 4
Monitoring Graphical Results ML3
15-Minute Sound Level Data

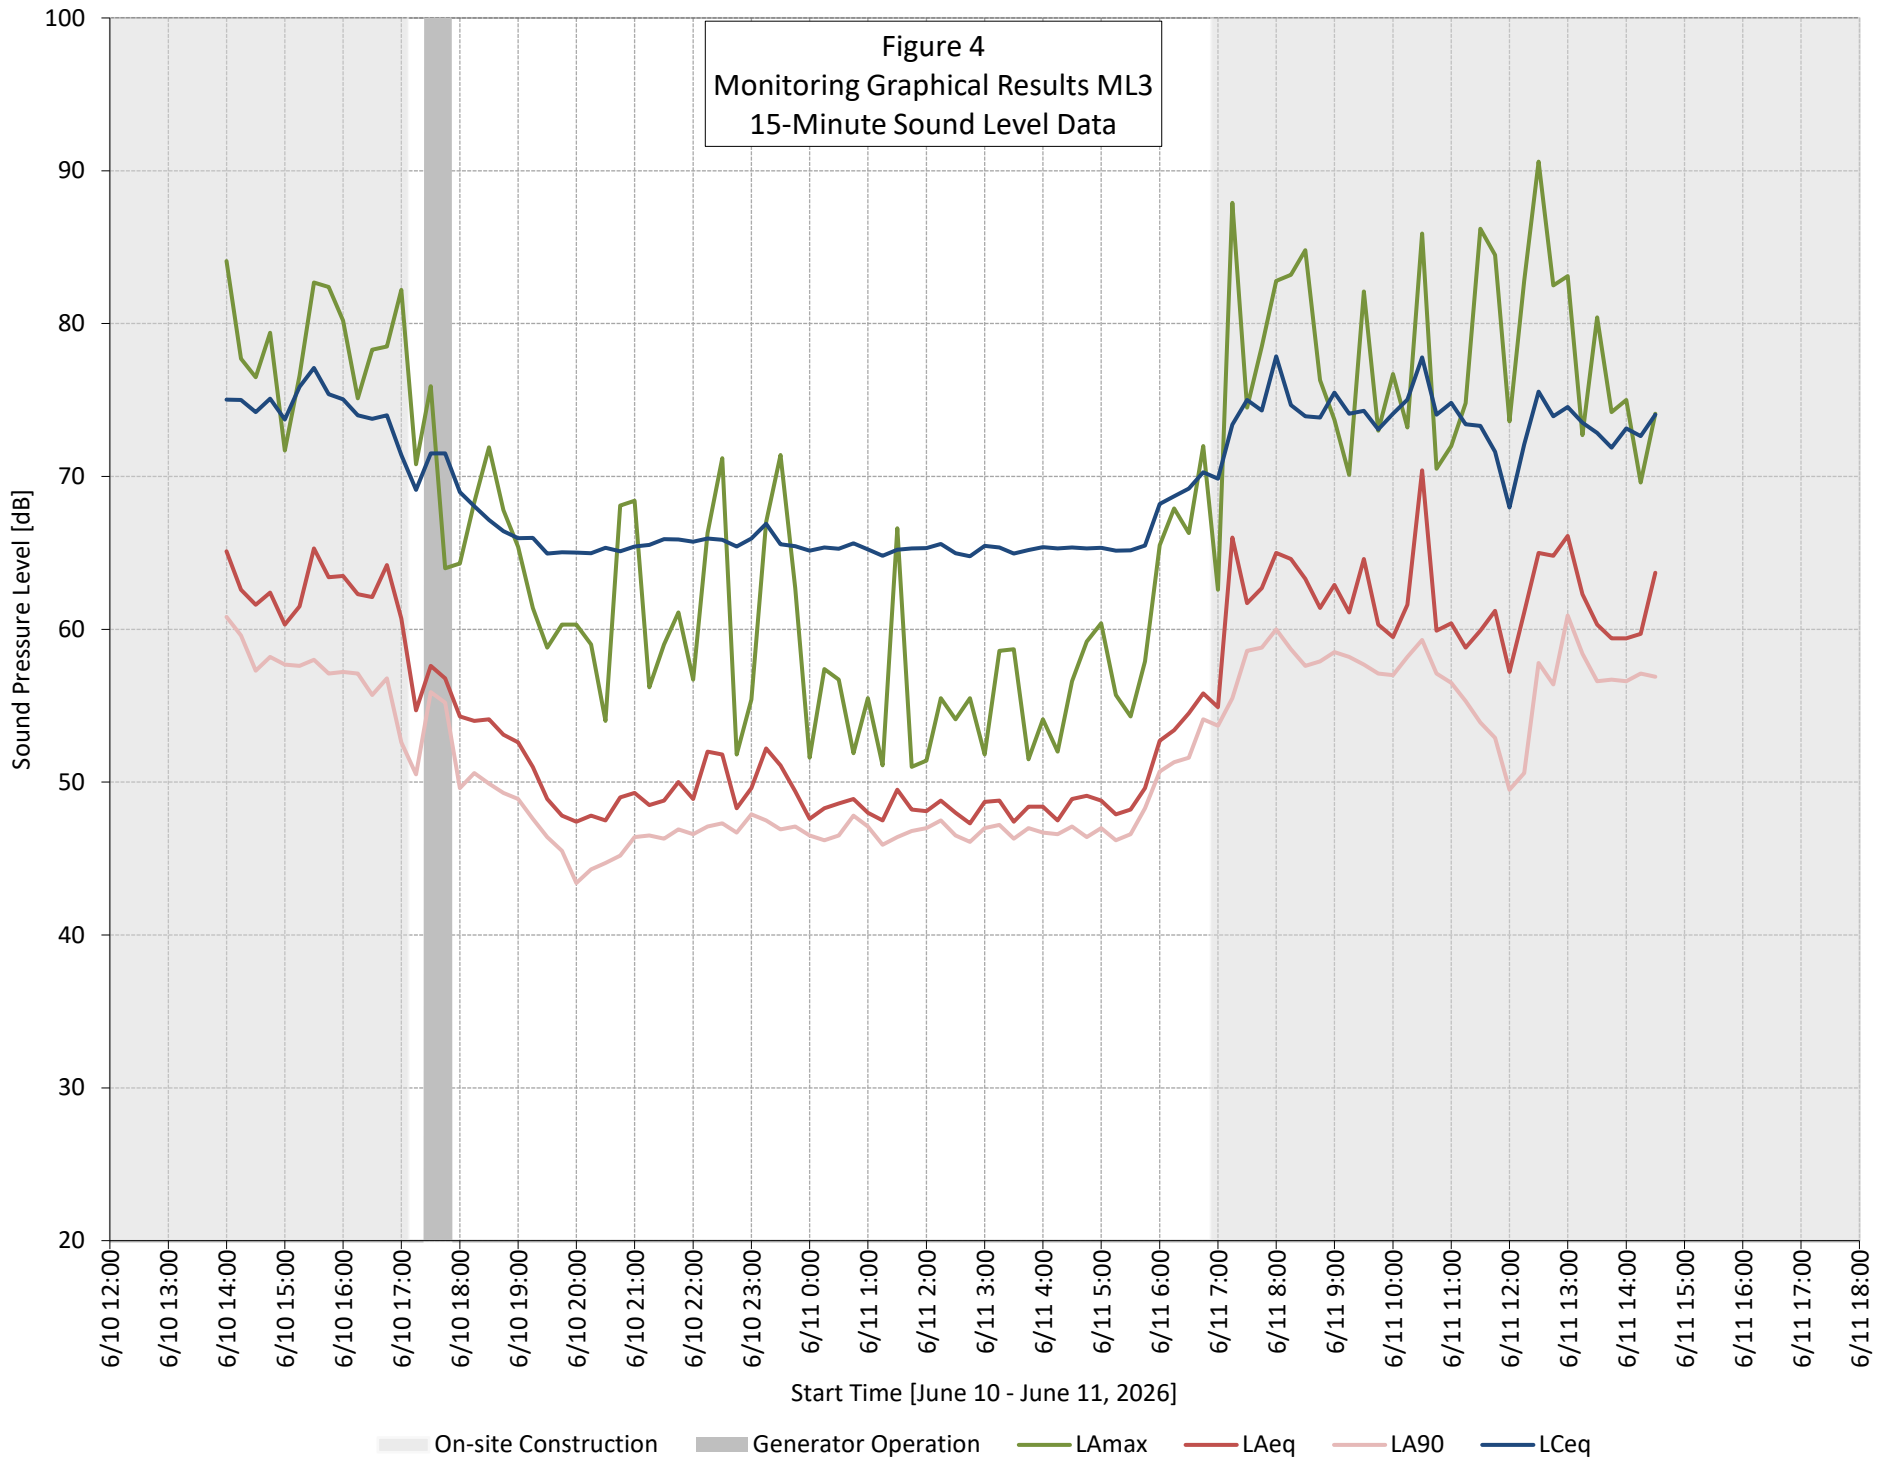


Table 1 - One-Third Octave Band Sound Levels (6.3 Hz to 20,000 Hz)

Loc.	Start Date/Time	One-Third Octave Band Leq Sound Pressure Levels (Unweighted, dB)																																			
		Infrasound					Low Frequency										Mid-High Frequency																				
		6.3	8	10	12.5	16	20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10k	12.5k	16k	20k
ML1	6/11/2026 0:00	43	44	47	44	46	46	46	48	50	57	52	53	56	57	52	40	43	44	45	44	43	42	56	48	46	47	52	55	58	43	36	29	15	17	23	19
	6/11/2026 6:00	46	47	49	65	49	50	54	51	54	58	57	55	57	58	54	45	46	47	48	46	46	43	41	40	39	37	37	39	36	33	30	22	19	13	10	9
	6/11/2026 12:00	49	48	49	50	51	51	57	58	59	62	58	59	62	61	57	56	52	51	51	52	52	51	51	49	48	48	47	46	46	48	47	45	41	37	35	31
	6/10/2026 17:30	66	64	62	65	65	57	55	55	61	64	67	65	71	63	58	66	59	54	54	48	47	48	45	42	43	44	40	38	37	35	31	28	25	22	20	17
	6/10/2026 20:00	55	53	52	50	50	50	48	48	51	57	56	52	55	56	52	44	43	40	39	39	39	37	34	34	33	31	30	32	32	29	21	18	18	12	13	12
ML2	6/11/2026 0:00	42	45	48	45	46	46	46	48	49	54	54	48	51	50	47	44	40	39	41	40	38	38	40	36	33	33	40	39	46	34	31	22	15	9	11	9
	6/11/2026 6:00	46	47	50	64	49	50	56	52	56	58	59	52	53	54	49	46	45	47	49	43	42	41	40	39	37	35	33	33	33	41	43	23	31	27	16	14
	6/11/2026 12:00	50	49	49	49	51	50	56	56	58	58	55	53	55	53	51	48	47	45	44	43	41	40	39	37	36	34	32	31	28	28	24	22	21	11	11	9
	6/10/2026 17:30	67	65	61	65	64	57	58	56	61	62	69	65	74	66	55	53	48	50	53	49	49	47	43	41	42	41	36	33	30	30	25	20	15	12	13	12
	6/10/2026 20:00	48	47	47	47	50	51	49	49	51	53	53	49	52	51	49	45	40	39	38	37	36	34	32	32	29	27	26	26	27	25	40	21	18	10	10	9
ML3	6/11/2026 0:00	42	44	48	45	47	47	46	49	50	56	64	51	52	52	49	45	43	41	38	39	38	36	37	35	31	29	32	32	35	24	19	10	8	7	6	6
	6/11/2026 6:00	46	47	51	64	52	52	58	54	59	60	65	56	55	57	55	51	48	48	46	45	45	43	42	40	37	35	34	34	33	31	23	21	17	11	8	4
	6/11/2026 12:00	45	46	50	52	55	53	57	58	56	60	59	58	62	58	56	55	54	50	49	48	48	47	46	47	45	46	43	41	39	38	37	36	30	26	21	15
	6/10/2026 17:30	59	58	56	64	60	54	58	55	60	61	67	61	66	60	54	56	53	55	57	45	46	47	45	42	42	41	37	33	30	27	25	23	18	18	13	10
	6/10/2026 20:00	44	44	46	46	49	51	49	49	50	55	64	50	52	53	50	48	46	45	39	35	34	34	35	34	31	30	30	28	27	26	24	17	13	9	6	4

Note: Generator sound testing is shaded.

Table 2A: Prominent Discrete Tone Assessment - ML1

PDT Thresholds as Defined by ANSI Standard

Date	Start Time	Measured L_{eq} Sound Pressure Levels (dB) by 1/3 Octave Band Center Frequency (Hz)																												
		15 15 15 15 15 15 15 15 8 8 8 8 8 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5																												
		20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10k	12.5k
6/10/2026	3:15 PM	58	66	72	61	65	68	66	66	61	60	59	54	51	51	52	54	53	54	52	50	49	48	45	43	39	36	32	33	
6/10/2026	3:30 PM	58	61	70	62	70	69	65	64	61	59	60	54	50	51	50	52	53	52	54	55	49	49	48	45	43	40	36	30	24
6/10/2026	3:45 PM	56	62	72	61	66	67	65	66	61	60	57	53	50	49	50	52	53	52	53	56	49	48	49	44	40	37	33	26	21
6/10/2026	4:00 PM	55	58	63	62	65	67	64	66	59	57	55	51	47	51	50	51	51	50	52	53	47	45	43	41	37	34	29	23	20
6/10/2026	4:15 PM	55	60	63	64	70	68	64	65	60	59	55	52	49	50	52	52	52	51	52	52	48	47	45	42	39	35	30	26	21
6/10/2026	4:30 PM	55	58	62	63	69	68	63	64	59	57	54	52	49	49	51	50	50	49	49	53	46	44	43	40	35	32	27	22	18
6/10/2026	4:45 PM	55	58	61	60	68	68	64	63	60	58	54	51	48	49	51	52	52	51	51	55	49	47	45	42	39	36	32	26	20
6/10/2026	5:00 PM	53	57	56	58	68	64	60	61	58	55	50	46	45	48	48	48	50	48	48	50	45	44	41	38	35	31	27	27	15
6/10/2026	5:15 PM	52	53	52	59	61	61	61	58	56	54	50	46	43	44	45	45	46	44	44	48	41	38	35	38	34	26	22	18	14
6/10/2026	5:30 PM	57	55	55	61	64	67	65	71	63	58	66	59	54	54	48	47	48	45	42	43	44	40	38	37	35	31	28	25	22
6/10/2026	5:45 PM	58	56	58	60	63	68	65	72	64	58	66	58	54	54	48	47	48	44	41	42	43	38	36	33	31	26	22	19	17
6/10/2026	6:00 PM	54	53	54	55	59	62	59	65	59	54	58	52	48	49	45	44	43	40	39	38	37	33	32	35	31	22	22	19	15
6/10/2026	6:15 PM	53	52	55	54	58	57	53	56	56	54	48	43	42	43	42	43	45	43	39	40	38	34	31	29	25	24	16	13	14
6/10/2026	6:30 PM	54	54	59	53	58	57	52	56	56	54	48	46	45	44	44	43	45	43	38	39	37	35	31	31	23	24	26	15	16
6/10/2026	6:45 PM	54	53	52	53	58	57	53	56	56	54	48	46	45	45	44	44	45	40	38	44	35	31	30	26	24	20	16	14	16
6/10/2026	7:00 PM	52	50	51	53	58	56	52	56	56	53	48	42	41	42	43	44	45	41	39	43	35	31	29	27	25	18	17	15	13
6/10/2026	7:15 PM	51	49	51	51	57	56	53	55	55	52	45	41	41	41	41	41	43	40	37	37	34	30	29	29	25	18	16	14	10
6/10/2026	7:30 PM	49	47	49	51	58	56	53	55	56	52	44	42	40	40	40	41	41	38	36	35	33	31	30	30	28	20	16	19	13
6/10/2026	7:45 PM	48	47	48	51	57	55	53	56	56	52	44	44	41	41	41	41	38	35	35	34	33	31	31	29	27	21	16	21	12
6/10/2026	8:00 PM	50	48	48	51	57	56	52	55	56	52	44	43	40	39	39	39	37	34	34	33	31	30	32	32	29	21	18	18	12
6/10/2026	8:15 PM	48	46	47	52	58	57	53	56	56	53	47	44	41	40	41	40	37	35	35	33	30	28	30	34	28	20	18	18	11
6/10/2026	8:30 PM	48	46	47	51	58	56	54	56	56	53	42	42	39	39	39	40	37	35	35	33	30	28	28	31	29	20	21	20	13
6/10/2026	8:45 PM	47	45	46	50	57	55	52	56	56	52	43	44	41	42	45	43	40	37	36	36	35	34	34	37	32	24	22	21	14
6/10/2026	9:00 PM	48	46	48	51	58	53	53	56	57	52	43	43	42	43	44	45	42	40	38	37	36	33	35	37	31	24	23	20	14
6/10/2026	9:15 PM	48	46	47	50	58	52	54	56	57	52	42	42	42	43	42	43	39	37	36	37	37	35	36	36	28	28	20	17	12
6/10/2026	9:30 PM	48	47	49	54	59	55	55	57	58	53	44	42	42	43	43	43	39	37	36	38	47	40	37	40	32	31	19	15	14
6/10/2026	9:45 PM	50	48	49	51	58	54	54	56	57	54	46	47	44	44	44	43	39	39	37	39	50	42	38	38	28	26	22	15	13
6/10/2026	10:00 PM	49	48	50	54	58	54	54	57	57	53	49	47	44	44	43	43	41	40	39	39	49	43	43	38	31	27	23	16	13
6/10/2026	10:15 PM	49	49	50	51	58	54	53	57	57	54	47	47	46	45	46	46	46	42	41	41	51	46	46	41	32	28	22	14	13
6/10/2026	10:30 PM	49	48	50	52	58	53	54	56	57	53	45	46	47	49	47	47	47	43	42	42	52	49	49	43	33	29	26	16	13
6/10/2026	10:45 PM	47	47	48	50	57	54	54	56	57	53	42	41	42	43	42	42	47	43	42	40	50	50	49	45	33	29	25	14	13
6/10/2026	11:00 PM	49	50	51	52	58	53	54	57	58	53	45	46	45	45	44	43	47	47	46	42	51	52	51	48	37	32	27	15	12
6/10/2026	11:15 PM	51	59	60	51	58	58	54	57	58	53	46	49	47	47	48	47	48	45	43	42	48	51	50	52	38	32	26	14	12
6/10/2026	11:30 PM	45	46	47	49	57	52	53	56	57	52	40	42	48	49	47	46	47	45	43	41	46	51	50	53	39	32	23	13	12
6/10/2026	11:45 PM	47	47	47	50	58	53	54	56	57	52	43	44	46	46	45	45	45	53	48	45	46	54	55	56	42	35	28	15	13
6/11/2026	12:00 AM	46	46	48	50	57	52	53	56	57	52	40	43	44	45	44	43	42	56	48	46	47	52	55	58	43	36	29	15	17
6/11/2026	12:15 AM	45	46	47	50	57	52	54	57	57	53	42	44	45	44	43	43	40	55	46	43	45	50	54	59	43	36	29	14	14
6/11/2026	12:30 AM	47	46	47	50	57	52	53	56	57	52	43	43	43	44	43	43	40	51	43	41	41	47	52	59	43	35	27	14	13
6/11/2026	12:45 AM	47	47	47	49	57	53	53	56	57	52	40	42	43	44	44	44	40	43	39	39	38	44	50	59	44	36	25	14	14
6/11/2026	1:00 AM	46	45	46	49	57	53	53	56	57	52	40	43	44	44	44	44	40	37	38	38	37	40	49	59	45	36	26	16	14
6/11/2026	1:15 AM	47	47	47	49	57	52	54	56	57	52	40	42	43	44	43	43	38	36	37	37	36	39	48	59	45	36	25	15	14

Table 2A: Prominent Discrete Tone Assessment - ML1

PDT Thresholds as Defined by ANSI Standard

Date	Start Time	Measured L_{eq} Sound Pressure Levels (dB) by 1/3 Octave Band Center Frequency (Hz)																																		
		20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10k	12.5k						
6/11/2026	1:30 AM	50	49	49	50	57	52	54	56	57	52	41	43	46	48	47	45	42	37	36	37	35	37	48	59	45	35	24	15	14						
6/11/2026	1:45 AM	47	47	47	49	57	54	54	57	57	52	42	43	44	44	45	44	39	36	37	38	37	38	48	59	45	35	24	15	14						
6/11/2026	2:00 AM	47	47	48	50	57	55	54	56	57	52	42	44	45	44	44	44	39	37	36	38	37	38	47	58	44	35	24	15	14						
6/11/2026	2:15 AM	47	46	48	49	57	55	55	57	57	53	41	43	44	44	44	44	40	37	36	37	36	37	47	58	44	34	24	15	14						
6/11/2026	2:30 AM	45	46	47	49	56	55	54	56	57	52	40	42	43	44	43	44	39	36	36	37	36	38	46	57	43	33	23	14	14						
6/11/2026	2:45 AM	46	46	47	49	56	55	54	56	57	53	41	43	44	43	43	43	39	36	35	36	34	36	44	55	41	32	22	13	13						
6/11/2026	3:00 AM	49	48	49	51	57	55	54	57	57	53	42	43	45	44	44	43	39	36	36	37	36	37	43	54	41	31	21	13	13						
6/11/2026	3:15 AM	48	47	48	49	57	55	54	57	57	54	42	44	46	45	44	44	40	37	36	38	38	38	42	52	40	30	20	14	13						
6/11/2026	3:30 AM	45	45	46	49	57	55	54	57	57	53	41	43	44	43	43	43	39	36	36	37	36	37	38	47	38	28	19	16	13						
6/11/2026	3:45 AM	46	46	47	49	57	55	53	57	57	53	41	43	44	44	43	43	39	37	38	39	36	41	39	46	35	28	17	11	13						
6/11/2026	4:00 AM	50	47	48	49	57	56	55	57	57	53	43	45	45	45	44	44	40	37	38	39	37	40	36	42	32	27	17	11	13						
6/11/2026	4:15 AM	47	46	47	49	57	56	54	57	57	53	44	45	47	45	44	44	41	37	37	39	38	38	38	44	32	27	18	11	13						
6/11/2026	4:30 AM	50	47	48	51	57	55	54	57	58	53	42	45	47	46	45	45	41	37	37	39	38	36	36	41	30	27	17	11	13						
6/11/2026	4:45 AM	49	48	50	51	57	56	55	57	57	52	42	45	46	46	45	45	40	37	37	38	37	35	34	38	30	27	16	10	12						
6/11/2026	5:00 AM	50	48	50	51	58	56	55	57	58	53	45	45	46	46	46	45	41	38	38	38	36	35	34	35	32	28	16	11	12						
6/11/2026	5:15 AM	50	47	49	50	58	55	55	57	58	53	42	44	45	44	44	44	40	37	37	37	35	34	33	31	31	27	16	10	12						
6/11/2026	5:30 AM	48	47	50	51	58	55	54	57	58	53	42	43	44	44	44	44	40	38	36	36	35	33	32	30	30	27	16	10	11						
6/11/2026	5:45 AM	49	48	50	51	58	55	54	57	58	52	43	45	46	46	45	45	42	39	39	39	37	36	39	35	33	32	20	16	12						
6/11/2026	6:00 AM	50	54	51	54	58	57	55	57	58	54	45	46	47	48	46	46	43	41	40	39	37	37	39	36	33	30	22	19	13						
6/11/2026	6:15 AM	51	54	53	56	58	58	56	58	58	55	47	46	48	48	46	46	43	41	39	38	36	35	36	35	29	24	17	11	7						
6/11/2026	6:30 AM	51	56	59	58	66	61	58	60	59	55	47	47	48	49	47	47	47	44	45	43	41	39	39	34	30	26	20	15	11						
6/11/2026	6:45 AM	51	57	62	58	70	62	59	62	59	55	50	48	48	48	47	48	48	46	46	45	43	42	41	38	35	33	37	28	21						
6/11/2026	7:00 AM	51	56	62	58	70	63	59	63	58	55	50	47	47	48	47	48	48	46	46	46	42	40	37	35	30	27	21	14	10						
6/11/2026	7:15 AM	50	55	62	60	70	64	59	63	58	56	51	47	48	48	47	51	49	46	46	45	43	43	40	38	33	29	23	15	10						
6/11/2026	7:30 AM	53	57	64	63	69	65	65	63	60	57	53	50	49	50	51	51	51	49	51	51	50	47	44	44	42	43	31	22	15						
6/11/2026	7:45 AM	55	57	63	63	64	65	61	60	60	56	52	49	49	49	49	49	48	47	48	47	44	43	42	40	38	35	26	18	17						
6/11/2026	8:00 AM	55	57	62	64	69	66	65	66	60	57	52	50	50	50	49	49	49	48	50	52	45	43	42	39	37	38	33	21	14						
6/11/2026	8:15 AM	55	56	62	64	65	66	65	67	60	56	51	49	49	49	48	49	49	48	49	51	46	44	42	40	37	33	29	23	12						
6/11/2026	8:30 AM	55	56	63	64	63	66	63	62	59	56	51	49	47	47	46	45	45	44	46	48	42	43	41	39	36	35	30	24	18						
6/11/2026	8:45 AM	55	57	62	63	70	66	65	64	59	56	52	49	47	47	47	49	49	48	50	52	47	45	44	43	43	42	39	32	25						
6/11/2026	9:00 AM	56	62	63	62	70	65	65	65	61	56	54	49	47	48	48	48	49	47	49	49	46	44	42	40	39	42	39	30	25						
6/11/2026	9:15 AM	53	61	65	63	72	64	64	63	60	56	53	48	46	48	47	48	49	47	48	49	45	43	42	39	37	36	35	29	22						
6/11/2026	9:30 AM	53	63	65	62	70	65	64	64	60	56	53	47	47	48	47	48	48	47	48	50	44	43	41	39	36	35	31	24	18						
6/11/2026	9:45 AM	52	61	64	62	70	66	61	64	60	57	54	50	47	48	47	47	47	46	46	49	44	42	41	38	37	34	31	25	18						
6/11/2026	10:00 AM	53	58	61	62	70	66	62	64	60	56	53	48	47	48	48	48	49	48	49	49	48	46	44	42	44	42	42	37	29						
6/11/2026	10:15 AM	58	60	61	64	70	65	64	64	60	57	54	51	48	50	51	52	53	51	53	54	49	48	46	44	42	40	37	31	25						
6/11/2026	10:30 AM	57	63	63	64	65	66	62	64	62	57	55	52	51	51	51	51	51	51	52	52	50	50	48	46	45	43	40	35	31						
6/11/2026	10:45 AM	54	60	62	63	66	65	63	64	60	56	53	49	48	49	49	50	51	50	51	53	49	49	47	45	44	43	40	33	27						
6/11/2026	11:00 AM	54	58	62	63	69	65	63	65	60	57	53	52	51	51	51	50	51	50	51	52	48	47	47	45	46	43	40	34	27						
6/11/2026	11:15 AM	54	60	69	63	65	73	63	66	82	68	67	73	67	68	68	67	68	67	67	64	61	60	61	60	54	53	50	47	44						
6/11/2026	11:30 AM	54	58	61	63	68	66	64	64	66	62	55	55	58	55	61	59	58	57	57	58	57	58	57	56	56	55	52	49	46						

Table 2A: Prominent Discrete Tone Assessment - ML1

PDT Thresholds as Defined by ANSI Standard

		15	15	15	15	15	15	15	15	15	8	8	8	8	8	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5
Date	Start Time	Measured L _{eq} Sound Pressure Levels (dB) by 1/3 Octave Band Center Frequency (Hz)																												
		20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10k	12.5k
6/11/2026	11:45 AM	53	59	57	59	65	61	60	63	60	56	54	49	49	50	50	49	48	47	47	48	44	42	41	39	36	34	33	29	23
6/11/2026	12:00 PM	51	57	58	59	62	58	59	62	61	57	56	52	51	51	52	52	51	51	49	48	48	47	46	46	48	47	45	41	37
6/11/2026	12:15 PM	57	53	61	59	61	60	57	61	59	57	52	52	48	51	59	60	53	51	54	53	53	52	51	48	47	44	42	39	35
6/11/2026	12:30 PM	52	55	62	60	64	61	61	62	58	56	51	51	48	48	47	48	48	48	48	48	49	49	48	45	46	44	42	36	29
6/11/2026	12:45 PM	55	57	60	59	67	61	63	64	59	57	52	52	49	49	49	49	50	51	51	52	51	49	47	46	46	44	41	35	27
6/11/2026	1:00 PM	55	60	61	62	72	64	67	66	60	59	51	49	49	50	51	51	52	51	52	53	49	49	48	47	47	44	41	35	27
6/11/2026	1:15 PM	54	59	61	62	65	65	66	66	61	59	54	52	49	50	50	51	52	52	52	52	51	50	47	46	46	43	39	34	27
6/11/2026	1:30 PM	55	59	62	61	66	67	66	64	60	57	54	52	50	50	49	50	50	50	50	51	49	47	46	45	46	44	45	36	30
6/11/2026	1:45 PM	55	62	63	64	72	66	63	62	59	57	53	50	49	49	49	50	50	50	50	51	50	47	46	45	47	44	41	34	26
6/11/2026	2:00 PM	56	60	63	63	66	67	64	63	61	58	54	53	50	49	48	49	50	50	50	50	48	45	43	41	39	36	32	25	17
6/11/2026	2:15 PM	56	59	63	63	65	67	64	64	59	56	51	47	46	47	48	48	50	49	48	48	45	43	41	39	36	33	28	22	15
6/11/2026	2:30 PM	57	60	63	63	69	68	65	65	62	59	55	54	49	51	52	52	53	53	53	54	49	47	46	44	41	39	39	30	23
6/11/2026	2:45 PM	56	62	63	61	64	67	64	64	58	56	52	49	47	48	48	49	50	49	49	49	47	46	43	41	42	40	38	31	23
6/11/2026	3:00 PM	56	61	63	63	67	67	64	65	61	58	54	52	48	48	50	50	52	53	53	53	51	50	49	48	48	46	45	38	30
6/11/2026	3:15 PM	55	59	62	62	67	67	65	64	59	57	53	50	48	49	51	51	52	52	52	53	49	48	47	46	46	44	46	38	30

Table 2B: Prominent Discrete Tone Assessment - ML2

PDT Thresholds as Defined by ANSI Standard

Date	Start Time	Measured L _{eq} Sound Pressure Levels (dB) by 1/3 Octave Band Center Frequency (Hz)																													
		20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10k	12.5k	
6/10/2026	2:30 PM	55	60	76	62	72	67	61	61	54	53	51	50	48	49	51	50	50	49	48	47	46	45	43	40	37	33	28	23		
6/10/2026	2:45 PM	57	67	72	64	72	68	62	61	55	54	52	50	50	47	48	48	49	48	50	49	45	44	42	39	37	34	31	25	17	
6/10/2026	3:00 PM	57	67	71	64	73	67	61	60	54	52	48	46	46	46	46	46	47	46	47	47	43	42	40	38	36	34	30	26	17	
6/10/2026	3:15 PM	57	68	75	65	74	67	62	62	54	52	50	48	47	47	46	47	47	46	48	46	44	43	46	39	37	34	31	26	20	
6/10/2026	3:30 PM	57	64	74	63	71	68	64	62	54	52	49	48	48	48	47	47	48	47	49	52	44	44	49	39	37	34	30	23	17	
6/10/2026	3:45 PM	57	64	73	62	72	63	62	62	55	52	50	48	48	48	48	47	48	47	50	50	44	43	43	38	35	33	30	24	18	
6/10/2026	4:00 PM	57	61	64	63	73	67	61	63	56	55	52	50	49	49	50	49	50	49	49	49	46	44	43	40	37	34	30	26	19	
6/10/2026	4:15 PM	55	60	63	63	73	68	62	62	56	55	52	50	49	49	49	48	49	48	49	50	46	43	41	39	36	33	28	23	16	
6/10/2026	4:30 PM	55	59	62	64	73	68	60	60	55	54	51	50	49	49	49	48	49	48	48	50	45	44	43	38	35	33	28	23	17	
6/10/2026	4:45 PM	56	59	62	62	72	68	65	60	56	56	54	50	50	50	51	51	51	51	51	52	48	46	44	41	39	36	33	27	20	
6/10/2026	5:00 PM	54	59	57	59	72	63	63	61	52	51	47	43	44	46	48	47	48	47	48	49	45	44	42	38	36	33	33	35	18	
6/10/2026	5:15 PM	52	55	54	57	59	62	63	58	52	49	45	43	44	44	43	43	43	41	42	43	39	38	35	37	32	29	27	22	17	
6/10/2026	5:30 PM	57	58	56	61	62	69	65	74	66	55	53	48	50	53	49	49	47	43	41	42	41	36	33	30	30	25	20	15	12	
6/10/2026	5:45 PM	56	58	60	61	63	70	66	75	65	55	52	47	49	53	49	48	47	42	40	42	40	35	32	29	25	21	15	15	9	
6/10/2026	6:00 PM	54	56	55	57	59	63	60	67	58	51	48	46	47	48	43	43	42	39	39	38	36	31	29	28	24	18	14	15	10	
6/10/2026	6:15 PM	52	55	57	55	57	57	53	53	52	50	48	43	44	44	40	39	40	39	38	39	37	33	28	25	23	19	13	15	9	
6/10/2026	6:30 PM	53	58	63	52	55	55	50	53	52	51	48	46	44	43	42	41	41	39	37	39	36	32	29	26	21	19	12	15	10	
6/10/2026	6:45 PM	52	53	52	54	55	55	50	53	53	52	49	46	45	44	42	40	40	38	38	45	34	29	27	23	19	31	14	15	9	
6/10/2026	7:00 PM	49	49	52	54	53	54	48	52	51	48	48	41	41	42	41	40	40	38	38	40	34	30	27	25	29	39	23	26	23	
6/10/2026	7:15 PM	50	48	52	52	53	53	48	52	51	48	46	40	39	39	38	37	37	36	36	35	33	29	27	25	22	35	17	17	10	
6/10/2026	7:30 PM	51	48	50	51	53	52	49	52	51	48	45	41	40	39	38	36	35	34	33	32	30	28	28	24	20	18	11	17	10	
6/10/2026	7:45 PM	49	48	50	51	53	53	50	53	52	49	45	43	42	40	38	36	35	33	33	30	28	28	27	26	23	41	22	19	10	
6/10/2026	8:00 PM	51	49	49	51	53	53	49	52	51	49	45	40	39	38	37	36	34	32	32	29	27	26	26	27	25	40	21	18	10	
6/10/2026	8:15 PM	48	47	48	51	53	54	49	52	51	49	46	41	39	39	39	37	35	33	33	30	28	27	27	28	25	23	16	17	9	
6/10/2026	8:30 PM	49	48	49	51	53	54	51	52	51	48	45	39	37	38	38	36	34	33	34	29	28	26	26	28	27	22	18	18	10	
6/10/2026	8:45 PM	48	46	48	50	53	53	48	52	51	48	45	41	41	41	43	39	37	35	35	32	31	30	29	30	29	25	19	17	10	
6/10/2026	9:00 PM	49	48	50	51	54	53	49	51	50	47	45	41	40	41	41	39	38	36	36	31	29	28	29	30	29	28	20	18	13	
6/10/2026	9:15 PM	48	47	49	50	54	53	49	51	50	47	45	41	41	41	40	38	36	35	35	31	30	30	30	27	26	32	17	16	11	
6/10/2026	9:30 PM	48	48	50	54	57	55	50	51	51	47	45	41	40	41	41	38	36	35	35	31	31	31	31	29	27	36	19	18	12	
6/10/2026	9:45 PM	50	49	50	51	54	54	50	52	52	49	46	45	43	43	43	40	38	37	36	33	35	35	31	29	27	34	20	19	12	
6/10/2026	10:00 PM	50	49	50	51	54	54	50	52	52	49	47	44	43	42	41	39	37	36	35	31	32	34	33	32	28	34	20	18	12	
6/10/2026	10:15 PM	50	50	51	51	54	54	50	52	53	52	49	47	46	46	47	45	43	40	40	37	35	38	37	36	29	34	21	18	12	
6/10/2026	10:30 PM	50	49	51	51	54	54	50	52	52	49	46	44	46	46	45	44	42	39	37	34	35	41	40	37	29	34	21	17	11	
6/10/2026	10:45 PM	47	47	48	50	54	54	50	52	51	47	45	40	39	40	39	37	41	38	37	34	35	42	41	39	30	34	22	17	11	
6/10/2026	11:00 PM	51	51	51	52	55	55	50	52	52	50	47	44	43	43	41	39	42	39	37	34	36	42	42	40	31	33	21	16	11	
6/10/2026	11:15 PM	53	58	55	50	55	56	50	51	51	49	46	45	44	45	44	43	43	41	39	35	36	42	41	42	32	32	21	15	9	
6/10/2026	11:30 PM	46	46	48	48	54	54	49	50	50	47	44	40	40	42	41	41	42	39	37	34	36	42	41	44	33	32	22	16	9	
6/10/2026	11:45 PM	46	47	48	49	54	55	49	51	50	48	45	41	42	44	42	40	41	38	37	34	35	42	41	45	34	30	22	16	9	
6/11/2026	12:00 AM	46	46	48	49	54	54	48	51	50	47	44	40	39	41	40	38	38	40	36	33	33	40	39	46	34	31	22	15	9	
6/11/2026	12:15 AM	46	45	47	49	54	54	49	51	50	48	45	41	40	41	39	36	36	39	34	33	30	36	37	46	34	31	21	15	9	
6/11/2026	12:30 AM	47	46	48	49	54	54	49	50	50	48	45	41	40	41	40	38	36	37	34	32	29	35	37	47	34	31	21	15	10	

Table 2B: Prominent Discrete Tone Assessment - ML2

PDT Thresholds as Defined by ANSI Standard

Date	Start Time	Measured L _{eq} Sound Pressure Levels (dB) by 1/3 Octave Band Center Frequency (Hz)																														
		20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10k	12.5k		
6/11/2026	12:45 AM	47	46	48	48	54	55	48	51	51	47	44	40	39	41	41	39	37	37	36	33	30	34	37	47	34	31	20	14	10		
6/11/2026	1:00 AM	47	45	47	48	53	54	48	50	50	48	44	40	39	40	40	37	36	35	35	31	29	32	38	47	34	30	21	14	9		
6/11/2026	1:15 AM	47	46	48	48	54	54	48	50	50	47	44	39	39	40	39	37	36	34	34	30	28	31	37	47	33	31	20	13	9		
6/11/2026	1:30 AM	50	49	50	50	54	54	48	50	51	48	44	40	42	43	42	40	37	35	34	31	28	30	36	46	34	33	21	13	9		
6/11/2026	1:45 AM	47	47	49	49	54	55	48	51	51	48	44	40	40	42	41	38	36	35	34	31	28	30	36	46	34	33	21	13	9		
6/11/2026	2:00 AM	48	47	49	49	53	55	48	51	52	48	45	39	39	41	40	39	37	35	35	31	29	30	36	45	33	31	20	12	8		
6/11/2026	2:15 AM	47	46	49	48	53	55	49	52	52	48	45	39	39	41	40	39	36	36	35	31	29	30	34	43	31	30	20	11	8		
6/11/2026	2:30 AM	45	46	48	48	53	54	47	51	52	48	44	39	38	40	40	38	36	36	35	31	29	29	33	42	31	30	19	11	8		
6/11/2026	2:45 AM	45	46	48	48	53	55	49	51	51	48	44	39	39	41	40	39	36	36	35	31	29	29	32	41	31	30	20	11	8		
6/11/2026	3:00 AM	48	48	49	50	53	55	49	52	52	48	45	39	39	41	41	39	36	35	34	30	28	29	31	39	30	31	19	11	8		
6/11/2026	3:15 AM	47	47	49	49	54	55	49	52	52	49	45	40	40	41	41	39	37	35	35	30	29	29	30	35	28	33	19	10	9		
6/11/2026	3:30 AM	45	45	47	48	53	54	49	52	52	48	45	39	39	41	40	39	36	35	35	30	29	29	29	33	29	30	17	10	8		
6/11/2026	3:45 AM	46	46	47	48	54	54	47	51	52	48	45	39	39	41	40	38	36	36	35	31	29	30	29	32	30	27	17	10	7		
6/11/2026	4:00 AM	49	47	48	49	54	55	49	52	52	48	45	39	39	41	40	39	37	35	35	31	29	30	28	29	27	26	17	10	7		
6/11/2026	4:15 AM	47	46	47	48	53	55	50	52	52	48	45	39	39	41	40	38	37	35	35	31	29	29	28	30	26	27	17	10	7		
6/11/2026	4:30 AM	49	47	50	50	54	55	49	52	53	49	45	39	39	41	41	40	37	35	34	30	29	30	28	29	29	27	17	9	7		
6/11/2026	4:45 AM	49	48	50	50	54	55	50	52	52	48	45	40	40	41	41	40	37	35	33	30	28	27	26	26	29	27	17	8	7		
6/11/2026	5:00 AM	50	48	49	50	54	55	50	52	52	49	45	39	40	41	41	40	38	35	34	30	28	27	26	26	28	27	17	8	7		
6/11/2026	5:15 AM	50	48	48	49	54	55	50	52	52	48	45	38	38	40	39	38	37	35	34	30	28	27	25	24	27	26	17	8	7		
6/11/2026	5:30 AM	48	47	50	50	54	55	49	51	52	48	45	38	38	39	39	38	37	35	34	30	28	27	27	23	27	29	16	17	13		
6/11/2026	5:45 AM	49	49	51	51	56	56	51	52	52	48	45	41	41	43	41	40	39	37	36	33	31	31	31	31	44	45	23	34	30		
6/11/2026	6:00 AM	50	56	52	56	58	59	52	53	54	49	46	45	47	49	43	42	41	40	39	37	35	33	33	33	41	43	23	31	27		
6/11/2026	6:15 AM	51	56	53	56	58	59	54	54	54	50	46	44	45	46	44	42	40	40	38	35	33	33	33	31	29	25	17	10	7		
6/11/2026	6:30 AM	51	60	58	57	62	61	56	56	54	50	47	44	43	45	44	44	44	44	44	40	39	36	35	32	31	28	22	14	9		
6/11/2026	6:45 AM	53	62	62	58	65	62	57	58	55	50	48	45	45	45	44	44	45	44	45	42	40	38	37	34	30	28	22	15	10		
6/11/2026	7:00 AM	51	61	61	58	64	63	56	57	54	50	48	43	44	45	44	44	44	44	45	41	39	38	36	33	30	27	21	14	9		
6/11/2026	7:15 AM	51	61	62	59	65	65	58	58	54	50	48	45	45	46	45	46	45	45	45	42	41	42	40	40	34	34	25	17	14		
6/11/2026	7:30 AM	53	60	64	64	66	69	67	59	56	53	51	49	48	48	47	48	47	47	48	47	43	42	41	39	39	43	34	22	18		
6/11/2026	7:45 AM	55	58	62	65	62	65	62	56	54	52	50	47	47	48	45	45	44	43	44	43	41	39	37	35	34	31	24	19	13		
6/11/2026	8:00 AM	56	60	61	64	64	65	62	63	55	53	51	49	49	48	45	45	45	44	45	48	42	40	40	37	36	36	31	23	17		
6/11/2026	8:15 AM	56	57	61	64	63	65	62	64	54	52	50	47	47	47	45	44	45	44	45	48	42	41	39	37	35	32	35	30	16		
6/11/2026	8:30 AM	57	58	63	64	62	64	61	57	54	52	50	47	46	46	43	42	41	39	41	40	38	37	36	34	32	31	26	22	15		
6/11/2026	8:45 AM	56	60	61	65	65	66	65	60	54	52	51	48	47	47	46	46	46	45	47	47	43	42	40	37	38	35	35	23	16		
6/11/2026	9:00 AM	57	62	63	63	65	66	63	61	55	52	50	47	46	47	45	45	46	44	45	45	43	41	40	38	37	40	37	25	18		
6/11/2026	9:15 AM	53	61	65	63	66	63	64	60	54	51	48	44	44	46	44	45	46	45	46	45	43	41	39	37	36	36	31	23	18		
6/11/2026	9:30 AM	54	60	64	62	70	63	62	62	54	52	49	46	46	46	44	44	46	44	45	46	42	40	38	36	35	36	32	23	16		
6/11/2026	9:45 AM	52	58	62	63	70	64	60	60	55	52	55	48	47	47	45	44	45	43	44	46	40	38	37	34	35	33	27	23	15		
6/11/2026	10:00 AM	53	60	63	63	64	65	61	61	55	52	49	45	45	46	45	44	46	45	45	44	42	40	39	36	34	30	28	22	14		
6/11/2026	10:15 AM	60	62	64	66	68	64	65	61	58	53	52	49	49	49	49	49	50	49	51	50	46	44	43	42	40	37	34	28	22		
6/11/2026	10:30 AM	60	65	64	65	71	65	62	61	60	54	54	53	53	51	50	49	49	49	51	49	48	46	45	45	43	40	38	34	28		
6/11/2026	10:45 AM	54	60	63	64	71	64	63	62	55	52	49	46	46	46	45	45	46	45	46	46	42	41	39	36	34	32	29	22	15		

Table 2B: Prominent Discrete Tone Assessment - ML2

PDT Thresholds as Defined by ANSI Standard

		15	15	15	15	15	15	15	15	15	8	8	8	8	8	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5
Date	Start Time	Measured L _{eq} Sound Pressure Levels (dB) by 1/3 Octave Band Center Frequency (Hz)																												
		20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10k	12.5k
6/11/2026	11:00 AM	55	61	63	63	68	66	63	63	56	54	52	51	49	48	48	47	47	46	47	49	43	41	40	37	36	31	32	22	15
6/11/2026	11:15 AM	55	61	63	64	73	64	61	61	62	54	51	50	49	49	49	49	48	46	46	44	42	40	39	36	36	33	29	23	15
6/11/2026	11:30 AM	54	60	62	64	70	65	61	60	62	52	49	45	44	45	45	46	45	46	48	42	41	39	37	35	31	27	21	14	
6/11/2026	11:45 AM	54	60	59	60	70	60	58	57	56	51	48	43	44	43	43	43	44	42	43	43	38	37	35	34	30	25	21	21	10
6/11/2026	12:00 PM	50	56	56	58	58	55	53	55	53	51	48	47	45	44	43	41	40	39	37	36	34	32	31	28	28	24	22	21	11
6/11/2026	12:15 PM	56	54	58	59	58	61	55	56	56	52	48	46	43	43	43	43	41	38	40	37	36	34	32	30	28	25	22	19	11
6/11/2026	12:30 PM	53	55	58	60	66	60	59	57	54	52	49	47	45	43	42	41	40	39	38	38	37	36	34	32	31	28	24	19	11
6/11/2026	12:45 PM	56	59	59	59	64	59	60	59	54	53	50	49	46	46	45	45	45	44	44	45	41	39	37	36	35	35	28	20	14
6/11/2026	1:00 PM	55	61	60	61	70	62	62	63	54	53	49	48	47	47	47	46	48	47	48	49	45	45	42	39	37	35	33	28	19
6/11/2026	1:15 PM	55	61	62	63	73	63	61	60	55	53	50	48	47	47	47	46	47	46	46	45	44	42	40	39	36	33	29	25	16
6/11/2026	1:30 PM	55	61	66	63	72	67	64	59	54	53	49	46	46	46	46	46	46	45	46	48	42	41	39	36	36	33	29	23	15
6/11/2026	1:45 PM	56	64	65	65	69	67	61	61	54	54	51	49	49	48	47	47	47	47	47	48	43	41	40	37	37	34	32	25	16
6/11/2026	2:00 PM	56	63	67	65	73	66	61	59	55	55	52	50	49	48	48	47	47	46	46	47	44	42	41	38	39	35	31	24	15
6/11/2026	2:15 PM	56	62	66	65	73	65	60	59	53	52	48	45	45	45	44	44	46	45	45	44	42	40	39	35	37	33	28	22	15
6/11/2026	2:30 PM	58	63	66	65	69	68	65	62	57	57	54	53	51	51	52	52	53	52	51	52	49	47	45	43	41	38	35	31	25
6/11/2026	2:45 PM	56	61	65	63	73	66	60	59	53	52	49	47	46	46	45	45	46	45	45	44	42	40	39	34	37	33	28	22	15

Table 2C: Prominent Discrete Tone Assessment - ML3

PDT Thresholds as Defined by ANSI Standard

Date	Start Time	Measured L_{eq} Sound Pressure Levels (dB) by 1/3 Octave Band Center Frequency (Hz)																															
		15 15 15 15 15 15 15 15 8 8 8 8 8 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5																															
		20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10k	12.5k			
6/10/2026	2:00 PM	57	62	63	63	66	71	68	63	62	62	60	59	58	58	56	54	53	54	55	55	52	56	49	47	45	43	38	35	32			
6/10/2026	2:15 PM	56	63	71	62	65	69	68	67	60	59	58	58	56	55	54	51	50	52	53	53	51	52	46	44	42	39	36	32	27			
6/10/2026	2:30 PM	56	62	68	62	65	69	67	66	60	58	58	57	55	55	53	50	49	50	52	52	49	49	46	44	41	38	36	33	28			
6/10/2026	2:45 PM	57	64	67	63	66	70	67	66	62	61	60	59	57	54	53	51	50	50	55	50	49	49	45	46	42	40	38	35	30			
6/10/2026	3:00 PM	57	62	64	62	67	69	68	64	60	58	57	56	54	52	51	49	49	48	52	49	47	49	45	42	41	38	36	33	28			
6/10/2026	3:15 PM	57	65	68	66	68	70	70	68	61	59	58	57	55	54	52	51	50	49	53	49	48	50	46	42	39	37	34	32	31			
6/10/2026	3:30 PM	57	62	66	63	67	71	73	69	62	61	59	59	58	57	55	54	54	52	53	53	51	59	51	46	44	41	38	35	30			
6/10/2026	3:45 PM	57	62	65	62	70	69	68	68	61	60	59	58	57	55	52	51	52	50	52	51	49	57	50	43	41	38	35	32	28			
6/10/2026	4:00 PM	56	61	61	63	69	68	67	68	62	62	61	61	58	56	53	51	53	54	54	53	50	49	47	45	42	39	37	33	28			
6/10/2026	4:15 PM	57	62	60	63	65	68	66	66	62	61	61	60	57	55	52	50	51	52	53	51	49	48	46	43	40	37	34	30	26			
6/10/2026	4:30 PM	55	60	60	63	65	70	65	64	61	60	60	59	56	54	53	51	53	52	52	52	49	46	45	42	39	36	32	30	25			
6/10/2026	4:45 PM	56	61	60	62	65	69	66	64	62	62	61	60	58	57	54	52	54	56	55	54	51	49	48	45	43	40	37	33	29			
6/10/2026	5:00 PM	54	58	56	58	63	67	62	64	57	55	55	52	50	51	55	56	52	48	51	49	47	44	41	37	35	31	29	27	19			
6/10/2026	5:15 PM	52	56	54	58	61	67	60	56	55	53	53	50	48	45	43	44	45	44	45	47	40	37	35	36	32	29	26	20	17			
6/10/2026	5:30 PM	54	58	55	60	61	67	61	66	60	54	56	53	55	57	45	46	47	45	42	42	41	37	33	30	27	25	23	18	18			
6/10/2026	5:45 PM	54	59	57	60	61	67	61	66	60	54	57	53	54	55	45	45	47	44	42	41	40	35	32	30	29	22	19	16	11			
6/10/2026	6:00 PM	53	57	54	58	61	66	59	60	56	53	55	51	51	50	45	47	46	43	40	38	37	32	30	29	29	23	25	21	12			
6/10/2026	6:15 PM	52	56	55	57	60	65	58	54	54	54	55	49	47	44	42	45	48	46	42	42	39	35	31	28	28	25	21	16	12			
6/10/2026	6:30 PM	53	56	58	53	58	65	53	53	54	54	55	49	49	45	45	47	48	45	41	40	37	33	30	27	25	21	17	13	10			
6/10/2026	6:45 PM	53	53	53	54	57	64	53	53	54	54	53	49	47	45	44	45	46	43	40	43	34	32	29	26	24	19	16	12	9			
6/10/2026	7:00 PM	49	48	54	56	56	64	51	52	53	52	54	46	45	42	42	44	46	44	41	41	36	33	30	27	24	19	15	12	9			
6/10/2026	7:15 PM	51	49	54	53	56	65	52	52	53	51	52	47	46	41	39	41	43	43	40	37	34	32	30	27	25	20	16	13	10			
6/10/2026	7:30 PM	50	48	52	52	55	64	50	51	52	51	50	46	45	40	38	39	39	39	37	34	32	30	28	27	25	19	15	13	9			
6/10/2026	7:45 PM	49	47	49	50	56	64	50	52	53	51	48	47	45	40	37	35	35	35	34	32	30	29	28	26	25	30	18	12	10			
6/10/2026	8:00 PM	51	49	49	50	55	64	50	52	53	50	48	46	45	39	35	34	34	35	34	31	30	30	28	27	26	24	17	13	9			
6/10/2026	8:15 PM	49	47	48	50	55	64	52	52	52	50	49	47	45	40	37	36	35	35	34	32	30	29	27	30	29	20	19	16	10			
6/10/2026	8:30 PM	49	47	48	50	56	64	54	52	52	50	48	46	44	39	35	35	35	36	35	32	30	28	27	30	29	21	18	15	9			
6/10/2026	8:45 PM	48	46	47	50	55	64	50	52	52	50	48	47	45	40	40	38	38	39	37	35	34	31	30	32	31	21	20	18	10			
6/10/2026	9:00 PM	49	47	49	51	56	64	51	52	52	50	47	47	45	40	38	40	40	40	39	34	31	30	29	31	30	20	20	17	11			
6/10/2026	9:15 PM	49	48	49	50	57	65	51	52	52	51	47	46	45	39	38	39	38	38	37	34	31	30	30	26	23	18	13	10	8			
6/10/2026	9:30 PM	49	48	50	52	57	65	52	54	55	51	48	46	45	40	39	39	38	38	37	33	32	30	30	27	23	19	13	10	8			
6/10/2026	9:45 PM	50	49	50	51	56	65	53	54	54	51	49	48	46	43	43	42	39	38	36	33	34	32	29	26	23	19	12	9	8			
6/10/2026	10:00 PM	50	49	51	52	57	65	52	53	52	51	49	47	45	42	41	41	38	37	35	32	31	31	29	26	22	18	12	9	7			
6/10/2026	10:15 PM	50	50	51	51	56	64	52	53	53	52	50	49	46	45	46	46	44	41	40	37	34	33	31	27	22	18	11	9	7			
6/10/2026	10:30 PM	50	49	51	51	57	64	52	53	53	51	48	47	47	45	45	48	44	39	37	33	32	34	32	28	22	18	11	8	7			
6/10/2026	10:45 PM	48	47	49	50	56	64	53	53	52	50	47	45	43	39	39	39	38	37	36	32	32	35	32	29	22	18	11	8	7			
6/10/2026	11:00 PM	51	51	51	52	57	65	52	53	53	51	48	47	45	41	40	39	39	39	37	34	34	36	35	32	24	19	12	9	8			
6/10/2026	11:15 PM	52	60	57	50	57	65	53	53	53	51	49	50	48	45	46	44	43	42	42	36	34	36	34	32	25	19	12	9	7			
6/10/2026	11:30 PM	46	46	48	49	56	65	51	51	52	50	47	45	45	44	45	46	42	39	38	35	34	36	34	34	25	19	12	9	8			
6/10/2026	11:45 PM	47	47	49	50	56	65	52	51	51	50	47	45	44	42	42	41	38	38	37	34	32	36	34	35	25	19	11	9	7			
6/11/2026	12:00 AM	47	46	49	50	56	64	51	52	52	49	45	43	41	38	39	38	36	37	35	31	29	32	32	35	24	19	10	8	7			

Table 2C: Prominent Discrete Tone Assessment - ML3

PDT Thresholds as Defined by ANSI Standard

Date	Start Time	15	15	15	15	15	15	15	15	8	8	8	8	8	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5
		Measured L _{eq} Sound Pressure Levels (dB) by 1/3 Octave Band Center Frequency (Hz)																												
		20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10k	12.5k
6/11/2026	12:15 AM	46	46	48	50	56	64	52	52	52	52	47	45	44	39	38	37	35	36	35	32	29	32	31	36	25	19	12	9	7
6/11/2026	12:30 AM	48	46	49	50	56	64	52	52	52	51	48	46	44	41	40	39	37	36	35	32	29	31	31	37	26	19	12	9	7
6/11/2026	12:45 AM	48	47	48	49	56	65	51	51	52	49	47	45	44	39	40	39	37	37	36	33	32	33	33	39	28	20	12	9	7
6/11/2026	1:00 AM	47	45	47	48	55	65	52	51	51	50	44	43	41	37	38	38	36	37	37	33	31	31	32	38	27	19	10	7	7
6/11/2026	1:15 AM	47	46	49	49	56	64	51	51	51	49	46	44	43	39	38	37	35	35	35	31	29	30	30	37	26	19	12	9	7
6/11/2026	1:30 AM	50	49	50	50	56	64	52	51	51	50	47	45	44	43	44	44	39	36	35	32	30	29	30	36	26	19	12	9	7
6/11/2026	1:45 AM	47	47	50	49	56	65	51	52	52	49	46	45	43	40	41	40	36	36	35	32	29	30	30	37	26	19	12	9	7
6/11/2026	2:00 AM	48	48	50	49	55	65	52	51	52	49	45	45	43	39	41	39	36	37	37	33	29	30	29	35	25	18	11	8	7
6/11/2026	2:15 AM	47	47	49	49	55	65	54	53	53	50	47	46	44	40	40	39	37	38	38	34	30	30	30	35	25	19	13	9	7
6/11/2026	2:30 AM	46	46	49	49	55	64	52	51	52	49	46	45	43	39	40	40	37	37	36	32	29	29	29	34	25	18	12	9	7
6/11/2026	2:45 AM	46	47	49	49	55	64	52	51	51	47	44	43	41	39	41	40	36	36	35	31	27	28	27	33	23	17	9	7	7
6/11/2026	3:00 AM	49	49	50	51	56	64	53	53	52	50	47	46	44	40	43	40	37	37	36	32	29	29	28	31	24	19	12	9	7
6/11/2026	3:15 AM	47	47	49	49	56	64	52	52	52	51	48	46	44	42	43	41	36	37	36	33	29	29	28	28	23	18	12	9	7
6/11/2026	3:30 AM	45	46	48	49	55	64	53	53	52	47	45	44	41	39	41	39	36	36	36	32	28	28	26	27	22	16	9	7	7
6/11/2026	3:45 AM	47	46	49	49	56	64	51	52	53	51	47	46	44	39	40	39	37	38	37	34	30	30	28	27	23	18	12	9	7
6/11/2026	4:00 AM	50	48	49	49	56	64	53	52	52	50	47	46	44	41	42	40	37	37	36	33	30	29	27	25	23	17	12	9	7
6/11/2026	4:15 AM	48	47	48	49	56	65	52	52	52	48	45	44	42	41	41	39	36	37	35	32	29	28	26	24	20	15	9	7	7
6/11/2026	4:30 AM	50	48	50	51	56	64	52	53	53	52	47	45	44	42	43	41	37	37	35	32	30	29	27	25	22	17	12	9	7
6/11/2026	4:45 AM	50	49	51	51	56	64	53	53	53	51	47	45	44	43	44	42	38	37	35	31	29	28	26	24	21	16	11	9	7
6/11/2026	5:00 AM	51	49	51	51	57	64	54	53	53	51	47	44	42	42	44	42	38	37	35	32	28	27	24	22	19	14	8	7	7
6/11/2026	5:15 AM	51	49	50	51	56	64	54	53	52	49	48	45	43	41	41	39	37	37	35	31	29	28	26	23	21	16	11	9	7
6/11/2026	5:30 AM	49	49	51	51	56	64	53	53	53	51	47	44	43	41	41	40	37	37	35	32	29	28	26	25	22	16	13	10	8
6/11/2026	5:45 AM	50	51	52	53	57	64	54	54	53	50	47	44	43	42	43	42	40	40	38	34	32	32	32	31	29	19	20	17	10
6/11/2026	6:00 AM	52	58	54	59	60	65	56	55	57	55	51	48	48	46	45	45	43	42	40	37	35	34	34	33	31	23	21	17	11
6/11/2026	6:15 AM	53	58	56	61	60	66	58	56	55	53	51	48	47	47	46	47	45	44	42	38	35	34	33	30	28	26	24	22	18
6/11/2026	6:30 AM	53	60	58	60	62	66	59	58	55	53	51	49	48	47	47	46	45	45	46	42	40	36	35	32	29	27	24	21	20
6/11/2026	6:45 AM	56	61	61	61	64	67	59	60	56	53	53	50	49	48	48	48	46	46	47	44	42	40	37	35	32	31	28	24	21
6/11/2026	7:00 AM	53	59	58	60	64	67	59	59	55	53	53	49	48	47	45	45	44	45	46	44	42	40	37	35	31	28	21	16	11
6/11/2026	7:15 AM	54	60	62	62	69	68	61	62	58	57	58	56	58	54	51	50	48	49	51	48	47	63	52	42	41	36	33	31	26
6/11/2026	7:30 AM	55	61	64	67	68	69	69	63	63	60	59	58	58	55	52	50	49	50	52	51	49	48	46	44	42	39	36	31	26
6/11/2026	7:45 AM	57	60	65	69	65	70	65	62	63	57	57	55	57	55	51	51	49	49	51	49	48	57	48	44	42	39	36	33	29
6/11/2026	8:00 AM	58	60	63	68	66	69	70	75	64	59	61	57	59	58	55	56	54	52	55	55	51	52	48	46	44	43	37	35	32
6/11/2026	8:15 AM	58	59	63	66	67	68	68	67	64	58	58	56	57	55	51	51	49	49	54	57	50	58	49	45	43	39	37	34	29
6/11/2026	8:30 AM	59	59	64	66	65	68	66	64	63	60	60	58	59	55	52	50	49	49	55	56	50	49	47	45	43	40	37	34	29
6/11/2026	8:45 AM	59	61	64	67	64	68	68	64	62	59	59	56	55	54	51	50	48	48	52	52	50	48	46	44	42	40	37	33	28
6/11/2026	9:00 AM	59	62	66	65	66	71	68	65	63	63	60	64	56	57	53	51	49	49	53	52	51	49	47	45	44	41	40	36	32
6/11/2026	9:15 AM	56	62	68	67	65	69	67	64	62	58	57	56	56	54	51	49	47	47	49	51	50	49	47	45	44	42	39	37	32
6/11/2026	9:30 AM	56	62	66	64	65	67	68	66	61	60	58	56	59	54	52	50	49	49	50	52	51	60	51	46	45	43	40	37	33
6/11/2026	9:45 AM	54	60	62	65	66	67	66	65	61	57	56	54	52	51	49	48	47	46	54	50	49	47	45	43	42	39	36	33	29
6/11/2026	10:00 AM	55	60	62	67	69	68	67	65	61	56	55	52	51	50	48	47	47	47	49	49	50	48	45	43	42	39	37	34	29
6/11/2026	10:15 AM	57	61	64	69	70	68	67	65	64	58	59	58	57	54	51	50	50	49	51	52	50	48	46	45	43	40	37	33	28

Table 2C: Prominent Discrete Tone Assessment - ML3

PDT Thresholds as Defined by ANSI Standard

		15	15	15	15	15	15	15	15	15	8	8	8	8	8	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
Date	Start Time	Measured L _{eq} Sound Pressure Levels (dB) by 1/3 Octave Band Center Frequency (Hz)																													
		20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10k	12.5k	
6/11/2026	10:30 AM	63	66	66	68	69	70	67	66	67	63	66	67	66	63	61	59	59	59	63	58	57	55	54	54	53	51	49	45	42	
6/11/2026	10:45 AM	55	61	63	68	68	68	66	65	61	56	56	53	51	49	47	47	47	48	50	50	50	48	45	43	43	41	38	33	27	
6/11/2026	11:00 AM	56	61	63	67	69	70	66	67	61	57	56	54	53	51	49	48	48	48	51	51	49	47	45	43	42	40	37	33	28	
6/11/2026	11:15 AM	56	60	61	67	68	67	65	64	60	58	55	54	51	50	49	50	48	47	48	47	47	46	43	41	40	38	34	26	19	
6/11/2026	11:30 AM	55	60	60	67	69	66	65	64	59	56	54	51	50	49	47	47	47	47	49	50	50	49	49	46	45	42	39	34	29	
6/11/2026	11:45 AM	56	60	61	62	68	64	62	62	60	56	55	55	53	51	49	48	46	49	58	48	46	46	44	44	42	39	35	30	29	
6/11/2026	12:00 PM	53	57	58	56	60	59	58	62	58	56	55	54	50	49	48	48	47	46	47	45	46	43	41	39	38	37	36	30	26	
6/11/2026	12:15 PM	58	56	64	62	64	66	63	64	61	59	57	56	57	53	49	46	45	45	47	46	46	56	47	42	42	40	38	33	28	
6/11/2026	12:30 PM	54	57	63	63	73	66	67	66	63	61	62	60	60	58	53	53	52	53	53	53	51	58	50	47	46	44	40	35	30	
6/11/2026	12:45 PM	57	60	62	61	70	64	65	64	61	61	60	60	58	56	53	52	51	51	52	53	51	60	50	45	44	41	37	33	28	
6/11/2026	1:00 PM	57	61	63	62	67	65	67	66	63	63	62	62	60	58	56	56	56	55	55	59	54	52	50	48	46	44	43	41	37	
6/11/2026	1:15 PM	58	61	62	63	69	65	66	63	60	60	60	59	56	55	52	50	50	51	52	52	51	50	48	45	44	42	39	37	31	
6/11/2026	1:30 PM	56	60	62	63	68	67	66	61	58	59	55	54	52	51	52	52	50	48	50	50	48	47	45	43	43	40	39	37	31	
6/11/2026	1:45 PM	56	61	62	65	64	66	63	63	58	59	54	54	52	51	49	48	48	48	49	48	48	47	45	43	43	40	39	38	32	
6/11/2026	2:00 PM	58	61	64	65	69	66	64	61	59	59	56	55	53	52	50	49	49	48	48	48	47	47	45	43	42	40	39	37	32	
6/11/2026	2:15 PM	57	61	63	65	69	66	63	61	59	59	56	55	54	51	49	49	50	49	49	48	48	47	45	42	41	38	38	36	32	
6/11/2026	2:30 PM	59	61	62	65	67	67	65	65	62	62	61	61	58	56	53	51	52	54	54	54	51	50	48	47	45	42	40	38	34	

Table 4: Vibration Perceptibility Assessment

Date	Start Time	Measured L_{eq} Sound Pressure Levels (dB) by Octave Band Center Frequency (Hz)								
		ML1			ML2			ML3		
		16 Hz	31.5 Hz	63 Hz	16 Hz	31.5 Hz	63 Hz	16 Hz	31.5 Hz	63 Hz
6/10/2026	2:00 PM							66	68	73
6/10/2026	2:15 PM							65	72	72
6/10/2026	2:30 PM				67	77	73	66	70	72
6/10/2026	2:45 PM				67	73	74	66	70	73
6/10/2026	3:00 PM				68	73	74	66	67	72
6/10/2026	3:15 PM	67	73	71	67	76	75	66	71	74
6/10/2026	3:30 PM	66	71	73	65	74	73	65	69	76
6/10/2026	3:45 PM	65	73	71	65	73	73	65	68	74
6/10/2026	4:00 PM	66	66	70	66	68	74	66	66	73
6/10/2026	4:15 PM	67	67	73	66	67	74	66	67	71
6/10/2026	4:30 PM	66	66	72	66	67	75	66	66	72
6/10/2026	4:45 PM	66	65	72	67	66	74	66	65	72
6/10/2026	5:00 PM	64	62	70	65	63	73	64	62	70
6/10/2026	5:15 PM	64	60	66	64	60	66	64	61	68
6/10/2026	5:30 PM	68	62	70	68	63	71	66	63	69
6/10/2026	5:45 PM	69	63	70	69	65	72	67	64	69
6/10/2026	6:00 PM	66	59	65	66	61	66	65	61	67
6/10/2026	6:15 PM	64	59	61	64	61	61	64	61	67
6/10/2026	6:30 PM	61	61	61	61	64	59	61	61	66
6/10/2026	6:45 PM	62	57	61	60	58	58	60	58	65
6/10/2026	7:00 PM	59	56	61	56	57	57	55	58	65
6/10/2026	7:15 PM	59	55	61	55	56	57	55	57	65
6/10/2026	7:30 PM	53	54	61	55	55	56	54	56	64
6/10/2026	7:45 PM	53	54	60	53	54	57	53	54	65
6/10/2026	8:00 PM	55	54	60	54	54	57	54	54	65
6/10/2026	8:15 PM	53	54	61	52	54	57	52	53	65
6/10/2026	8:30 PM	53	53	61	53	54	58	53	53	65
6/10/2026	8:45 PM	51	52	60	52	53	57	52	53	65
6/10/2026	9:00 PM	52	53	60	53	55	57	53	54	65
6/10/2026	9:15 PM	52	53	60	53	54	57	53	54	65
6/10/2026	9:30 PM	52	56	62	52	56	60	53	55	65
6/10/2026	9:45 PM	53	54	60	53	55	58	53	55	65
6/10/2026	10:00 PM	53	56	61	53	55	58	53	56	65
6/10/2026	10:15 PM	53	55	60	54	55	58	54	55	65
6/10/2026	10:30 PM	53	55	60	54	55	58	54	55	65
6/10/2026	10:45 PM	51	53	60	51	53	58	52	54	65
6/10/2026	11:00 PM	53	56	60	54	56	58	54	56	66
6/10/2026	11:15 PM	53	63	62	54	60	59	54	62	66
6/10/2026	11:30 PM	49	52	60	50	52	58	50	53	65
6/10/2026	11:45 PM	50	53	60	50	53	58	50	53	65
6/11/2026	12:00 AM	50	53	60	51	53	57	51	53	65
6/11/2026	12:15 AM	49	53	59	50	52	58	50	53	65
6/11/2026	12:30 AM	50	53	60	50	52	57	51	53	65
6/11/2026	12:45 AM	50	53	60	50	52	58	51	53	66
6/11/2026	1:00 AM	49	52	60	50	51	57	50	52	65

Table 4: Vibration Perceptibility Assessment

Date	Start Time	Measured L_{eq} Sound Pressure Levels (dB) by Octave Band Center Frequency (Hz)								
		ML1			ML2			ML3		
		16 Hz	31.5 Hz	63 Hz	16 Hz	31.5 Hz	63 Hz	16 Hz	31.5 Hz	63 Hz
6/11/2026	1:15 AM	49	53	60	50	53	57	50	53	65
6/11/2026	1:30 AM	53	54	60	53	54	57	53	55	65
6/11/2026	1:45 AM	49	53	60	50	53	58	50	54	65
6/11/2026	2:00 AM	50	53	60	51	53	57	51	54	65
6/11/2026	2:15 AM	50	53	60	50	52	58	51	53	65
6/11/2026	2:30 AM	49	52	60	49	52	57	50	53	65
6/11/2026	2:45 AM	49	52	60	49	52	58	49	53	65
6/11/2026	3:00 AM	52	54	60	52	54	58	52	55	65
6/11/2026	3:15 AM	50	53	60	50	53	58	50	54	65
6/11/2026	3:30 AM	49	52	60	49	52	57	49	53	65
6/11/2026	3:45 AM	49	52	60	50	52	57	50	53	65
6/11/2026	4:00 AM	52	53	61	52	53	58	52	53	65
6/11/2026	4:15 AM	51	52	61	52	52	58	52	53	65
6/11/2026	4:30 AM	53	54	60	53	54	58	53	54	65
6/11/2026	4:45 AM	52	55	61	52	54	58	53	55	65
6/11/2026	5:00 AM	53	54	61	53	54	58	54	55	65
6/11/2026	5:15 AM	54	54	61	54	53	58	55	55	65
6/11/2026	5:30 AM	51	54	61	52	54	58	52	55	65
6/11/2026	5:45 AM	57	55	61	56	55	59	56	57	65
6/11/2026	6:00 AM	65	58	62	64	60	62	64	62	67
6/11/2026	6:15 AM	64	59	62	64	60	62	65	64	67
6/11/2026	6:30 AM	64	62	68	64	63	65	64	64	68
6/11/2026	6:45 AM	64	64	71	64	66	67	64	66	69
6/11/2026	7:00 AM	63	64	71	63	65	67	63	64	69
6/11/2026	7:15 AM	61	65	71	63	65	68	64	66	72
6/11/2026	7:30 AM	63	67	72	64	68	72	65	70	73
6/11/2026	7:45 AM	65	67	69	65	67	68	66	71	72
6/11/2026	8:00 AM	64	66	72	64	67	69	65	70	73
6/11/2026	8:15 AM	62	66	70	63	67	68	64	68	72
6/11/2026	8:30 AM	63	67	69	64	67	68	65	69	71
6/11/2026	8:45 AM	63	66	72	64	67	70	65	69	72
6/11/2026	9:00 AM	63	67	72	65	67	69	65	69	74
6/11/2026	9:15 AM	63	68	73	64	68	70	64	71	72
6/11/2026	9:30 AM	63	68	72	64	67	71	64	69	72
6/11/2026	9:45 AM	62	67	72	64	66	71	63	67	71
6/11/2026	10:00 AM	64	65	72	65	67	68	64	69	73
6/11/2026	10:15 AM	65	67	72	67	69	71	65	70	73
6/11/2026	10:30 AM	65	68	69	66	70	73	67	71	74
6/11/2026	10:45 AM	64	66	70	65	68	72	63	70	72
6/11/2026	11:00 AM	63	66	71	65	67	71	64	69	73
6/11/2026	11:15 AM	63	70	74	64	68	74	63	69	72
6/11/2026	11:30 AM	63	66	71	63	67	72	61	68	72
6/11/2026	11:45 AM	61	63	67	61	64	71	61	66	70
6/11/2026	12:00 PM	55	63	65	55	61	60	58	62	64
6/11/2026	12:15 PM	61	63	65	60	62	64	61	67	69

Table 4: Vibration Perceptibility Assessment

Date	Start Time	Measured L_{eq} Sound Pressure Levels (dB) by Octave Band Center Frequency (Hz)								
		ML1			ML2			ML3		
		16 Hz	31.5 Hz	63 Hz	16 Hz	31.5 Hz	63 Hz	16 Hz	31.5 Hz	63 Hz
6/11/2026	12:30 PM	62	64	67	63	63	67	61	67	74
6/11/2026	12:45 PM	61	64	69	63	64	66	62	66	72
6/11/2026	1:00 PM	64	66	73	65	65	71	64	67	71
6/11/2026	1:15 PM	63	66	70	64	67	74	63	67	72
6/11/2026	1:30 PM	63	66	71	63	68	73	62	67	72
6/11/2026	1:45 PM	64	68	74	65	69	71	63	68	70
6/11/2026	2:00 PM	64	67	70	64	70	74	63	68	72
6/11/2026	2:15 PM	64	67	70	65	69	74	63	68	71
6/11/2026	2:30 PM	65	67	72	67	69	72	65	68	71
6/11/2026	2:45 PM	65	67	70	65	68	74			
6/11/2026	3:00 PM	64	67	71						
6/11/2026	3:15 PM	62	66	71						